


### FdxCompact I/O modules specifications

Introduction	2
Installation on DIN-rail	2
Power supply	2
Communication bus	
Measuring and controlling field devices	3
FdxCompact AI-8-C	
Resistance measurement	
Voltage measurement	4
Current measurement	
FdxCompact AO-8-C	
FdxCompact DI-16-C	
FdxCompact DO-8-C	
FdxCompact DOOC-16-C	
FdxCompact TRIAC-8-C	
Modbus registers	
FdxCompact AI-8-C	
FdxCompact AO-8-C	
FdxCompact DO 2 C	
FdxCompact DOOC 16.C	
FdxCompact DOOC-16-CFdxCompact TRIAC-8-C	
Connectors and colours	
FdxCompact Al-8-C	
FdxCompact AO-8-C	
FdxCompact DI-16-C	
FdxCompact DO-8-C.	
FdxCompact DOOC-16-C	
FdxCompact TRIAC-8-C	
Internal wiring and logic setup	21
FdxCompact AI-8-C	
FdxCompact AO-8-C	22
FdxCompact DI-16-C	
FdxCompact DO-8-C	
FdxCompact DOOC-16-C	
FdxCompact TRIAC-8-C	
Physical connections to sensors and controlled devices	
FdxCompact AI-8-C	
FdxCompact AO-8-C	
FdxCompact DI-16-C	
FdxCompact DO-8-C	
FdxCompact DOOC-16-C	
FdxCompact TRIAC-8-C	53



#### Introduction

The FdxCompact-line of products from Fidelix, are aimed to suit the modern 21<sup>st</sup> century requirements for I/O modules in terms of speed, size, and protective encasing. Their look has been altered drastically compared to the classic line of Fidelix products, and our FdxCompact modules all have the exact same size. This makes planning the construction of your electrical cabinet easier and faster.

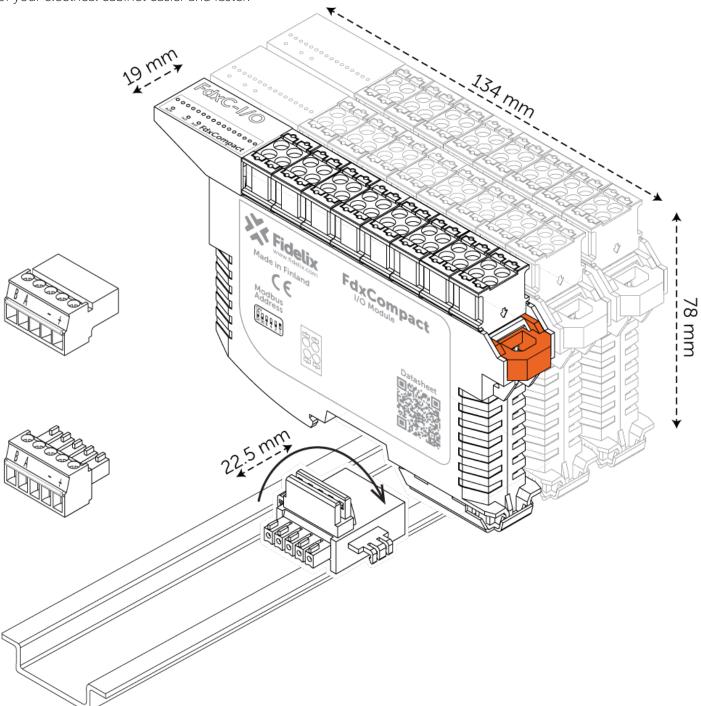

### Installation on DIN-rail

The T-bus connectors that are attached to the DIN-rail provide power (24VDC) and bus communication (serial Modbus RTU over RS485). The modules simply "click" onto the T-bus connector in the direction of the arrow above and so power the modules.

### Power supply

There is a signal led, blinking once per second, which indicates that the modules microcontroller's program is running.



#### Communication bus

Each module has signal LEDs for received (RxD) and transmitted (TxD) data. The RxD lights up for any received data package on the bus. The TxD LED lights up when the module sends an answer to the Modbus master.

The bus should be configured to have 8 databits and no parity. The FdxCompact modules automatically detect the speed and the number of stop bits on the data bus.

Fidelix modules support addresses from 1 to 63. These are set on the side of the module, using binary DIP-switches.

The following Modbus RTU function codes are supported:

16x03 / 10x03read multiple holding registers16x06 / 10x06write single holding register16x10 / 10x16write multiple holding registers16x16 / 10x22mask write register16x2B / 10x43read device identification

More details about each individual modules Modbus register later in this document.

### Measuring and controlling field devices

Please consult the datasheets of the FdxCompact I/O-modules on our website for details on how to connect field devices to our modules, or revert to the connection diagrams and examples later in this document.

#### FdxCompact AI-8-C

The FdxCompact AI-8-C module is used to measure resistance, voltage or current signals from external field sensors. Each channel's input connector is marked with its number (1..8). Each terminal block also has a DC, AUX and GND connector. The DC- and GND-connectors provide easy access to the 24 VDC and 0 VDC with which the module is powered from the click-on DIN-rail connectors. The AUX connectors are all connected to each other in a galvanically isolated loop, and can be used to provide, for instance, an external AC supply voltage to your sensors.

The Al-8-C module uses a delta sigma analogue to digital converter to convert the analogue measurements to 20-bit values. More details about how and where to read these digital values can be found in the Modbus registers section. The type of measurement (resistance, voltage, or current) is selected in Modbus registers 12 and 13. An indicator LED will light up per channel if "I" (current) or "V" (tension) is selected. If the channel's LEDs are both off, the module measures the resistance.

Make sure to always select the right type of measurements, as one wrongly configured channel can cause all measurements to return false values. This because of the resistances that are used (or not) based on the type of measurement.

#### Resistance measurement

A reference voltage of 3.33V is put through the internal  $4.7k\Omega$  resistor and the voltage drop over that resistor + the resistive sensor connected to the cannel is measured. This means the resistance of the connected sensor, when using only 16-bit accuracy (using only values from registers 0..7) can be calculated as follows:

$$R = \frac{4\,700\,\Omega*\,RegValue}{65\,535 - RegValue}.$$
 When 20-bit accuracy is required, use following equation: 
$$R = \frac{4\,700\,\Omega*\,20bitValue}{1\,048\,575 - 20bitValue}$$

Where **RegValue** is the value read from registers 0..7, and **20bitValue** is the value read from registers 0..7 combined with the right bits from registers 8 or 9.

Since firmware version 3.11 (released in August 2020), the Al-8-C module also provides the resistance measured directly as an Ohm value without decimals.

Resistive temperature sensors can be selected (NTC10k, PT1000, NTC20k, Ni1000-LG, or Ni1000-DIN), which will provide measurements with a 2 decimal accuracy in °C.



#### Voltage measurement

The voltage measurement range is from 0..10V. The input impedance is about 8.8 k $\Omega$ . The voltage measured can be converted from the single register value (using only values from registers 0..7) from 0..65535 to 0..10V.

This means the voltage can be calculated using following equation with the 16-bit register value:

$$V = \frac{\text{RegValue}}{6\,553.5}$$
. When 20-bit accuracy is needed, use following equation:  $V = \frac{20 \text{bitValue}}{104\,857.5}$ 

Where **RegValue** is the value read from registers 0..7, and **20bitValue** is the value read from registers 0..7 combined with the right bits from registers 8 or 9.

Since firmware version 3.11 (released in August 2020), the Al-8-C module also provides the tension measured directly as a Voltage value with 2 decimals.

#### Current measurement

The current measurement range is from 0mA to 25mA. The incoming current will flow through a  $100\Omega$  resistor and the voltage over that resistor is measured. This means the incoming current can be calculated using following equation with

the 16-bit register value:  $I = \frac{\text{RegValue}}{2\ 621\ 400}$ . When 20-bit accuracy is needed, use following equation:  $I = \frac{20 \text{bitValue}}{41\ 943\ 000}$ 

Where **RegValue** is the value read from registers 0..7, and **20bitValue** is the value read from registers 0..7 combined with the right bits from registers 8 or 9.

Since firmware version 3.11 (released in August 2020), the Al-8-C module also provides the current measured directly as an Ampère value with 2 decimals.

### FdxCompact AO-8-C

The FdxCompact AO-8-C module is used to send out voltage levels from 0..10V. The module has 8 independently controlled analogue output channels, which are galvanically isolated from other circuits on the module (the control circuit and power supply), but there is a galvanic connection between each output channel. Each channel's output connector is marked with its number (1..8). Each terminal block also has a DC, AUX and GND connector. The DC- and GND-connectors provide easy access to the 24 VDC and 0 VDC with which the module is powered from the click-on DIN-rail connectors. The AUX connectors are all connected to each other in a galvanically isolated loop, and can be used to provide, for instance, an external AC supply voltage to your sensors.

When the module has not received any Modbus packages for 2 minutes, each channel's output voltage can change to a predefined value, or keep its old voltage.

#### FdxCompact DI-16-C

The FdxCompact DI-16-C module has 16 optically isolated input loops. Only potential free contacts should be connected to the inputs. Each channel has an individual pulse counter register and a corresponding configurable minimum pulse width value between 5 and 1275 msec.

Each channel's Sx connector (S1..S16) provide +/- 20-24VDC that is detected by its corresponding numbered input (1..16).

The module has 1 green and 1 red LED per channel. The LEDs can either be controlled locally by the module itself (indication mode), or by the Modbus master (alarm mode). When on local control, the green LED will light up instantaneously when the loop between the Sx and the numbered connector is closed. When controlled by the Modbus master, the green or the red LED can be lit as a reaction to the channel's activation freely.

Each LED can also be individually set to blink or stay on steadily when active, regardless of it being controlled by the Modbus master or locally.



#### FdxCompact DO-8-C

The FdxCompact DO-8-C module has 8 relay outputs. Each relay has its own indication LED to show its status, the LED being lit meaning the xCOM and xNO (normally open) connectors are closed. This we call the active state of the relay. Each channel has 2 common connectors (market with "xCOM"), 1 normally open (xNO), and 1 normally closed (xNC) connector. This means you can connect two circuits to the same relay when needed.

Each channel is galvanically isolated. The maximum load per relay is 1 A at 30V.

If the module hasn't received any Modbus communication for 30 seconds (30 is the default value; this can however be changed), the relays can be configured to go to a certain status (active / non-active), or to remain at their old value (the last value received from the Modbus master).

The FdxCompact DO-8-C module also has a watchdog function. The module's watchdog can reboot for instance the controller it is connected to, in case of a rupture in communication. This can be done by connecting the controller's power supply through the 8<sup>th</sup> relay.

#### FdxCompact DOOC-16-C

The FdxCompact DOOC-16-C module has 16 open collector outputs. Each output has its own indication LED to show its status. Connect your indicating lamp or LED, or help relay between a connector marked "DC" and a number connector to connect the 24VDC from the module's power supply.

The maximum load per output is 100 mA at 24VDC. The minimum load per output is 2.5 mA.

Any smaller load will be detected as a short circuit. The detection of a short-circuit will cause the module to interrupt the short-circuited connection (de-activate the output) for a few seconds. The channel's LED indicator will be red during this time. After that, the module will activate the channel's output again. If a short-circuit is still detected, the same cycle of actions is repeated.

Not having any load on the channel, will cause the green LED to blink.

If the module hasn't received any Modbus communication for 30 seconds (30 is the default value; this can however be changed), the relays can be configured to go to a certain status (active / non-active), or to remain at their old value (the last value received from the Modbus master).

The FdxCompact DOOC-16-C module also has a watchdog function. The module's watchdog can reboot for instance the controller it is connected to, in case of a rupture in communication. This can be done by connecting the controller's power supply through the 8<sup>th</sup> relay.

#### FdxCompact TRIAC-8-C

The FdxCompact TRIAC-8-C module is used to send out TRIAC time-based control signals. The module has 8 independently controlled output channels.

To use the TRIAC outputs, provide 24 VAC from an external power source to the AC / G0 connectors of one of the channels. This same power source voltage will we shared by all channels.

The 24VAC provided to an AC connector will also be set directly to all of the Vx outputs.

When the module has not received any Modbus packages for 2 minutes, each channel's output voltage can change to a predefined value, or keep its old voltage.



### Modbus registers

All FdxCompact I/O modules solely work with Modbus holding registers (40 000 +).

FdxCompact I/O modules use a 0-based register numbering, meaning the first available register is register 0 (not register 1).

Read and write normal register values with Modbus function codes 3, 6 and 16 (16x0010).

Described registers are numbered from 0, meaning holding register 0 (or 40 000) onwards.

#### FdxCompact AI-8-C

Read only registers 0..7 contain the 16 most significant bits (MSB) of the measurement values of channels 1..8. For most applications, this value is accurate enough to use.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH1	CH1	CH1	CH1									СН	CH1	CH1	CH1
0	MSB	BIT19	BIT18	BIT17									BIT8	BIT7	BIT6	BIT5
REG	CH2															CH2
1	MSB															BIT5
L	1	l .	1	ı			1									

CH8 CH8 CH8 CH8 CH8 CH8 CH8 REG CH8 MSB BIT19 BIT18 BIT17 BIT8 BIT7 BIT6 BIT5

Read only registers 8 and 9 contain the 4 least significant bits (LSB) of the measurement values of channels 1..8. These 4 bits can be combined with the corresponding 16-bit value (from registers 0..7), to get 20-bit measurement data accuracy.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH4	CH4	CH4	CH4	CH3	CH3	CH3	CH3	CH2	CH2	CH2	CH2	CH1	CH1	CH1	CH1
8	BIT4	BIT3	BIT2	LSB												
REG	CH8	CH8	CH8	CH8	CH7	CH7	CH7	CH7	CH6	CH6	CH6	CH6	CH5	CH5	CH5	CH5
9	BIT4	BIT3	BIT2	LSB												

Read/Write register 10 controls the enabling or disabling of analogue input channels. If a bit is set to 1, the corresponding input channel is enabled, a bit at zero disables the corresponding channel. The first channel is always enabled (even if its value is zero). The possibility to disable channels is present to enable faster reading times of a small number of analogue inputs, for applications where this is necessary; one measurement (per channel) takes about 170ms. This means that when all 8 channels are enabled, each measurement is repeated every 1.36 seconds. Using fewer channels will thus result in a shorter polling time. Disable as many channels as needed until the required speed in response time is achieved. Only the 8 least significant bits of this register are used.

Important to know, is that after a power interruption, register 10 gets reset to its default value (16#0000). This allows for the module to be "hot swapped" in any communication bus loop. The configuration is thus fully relying on the Modbus client (previously master). Note that this means that the Modbus client (previously master) is supposed to continuously verify the register value to make sure the right channels on the module are enabled at all times.

	BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
F	REG	not	CH8	CH7	CH6	CH5	CH4	CH3	CH2	not							
	10	used	ENA	used													



Read/Write registers 12 and 13 define the type of measurement signal that is connected to each channel. Bits at 1 in register 12 set the corresponding channel's measurement type to voltage measurement, bits at 1 in register 13 set the corresponding channel's measurement type to current measurement. If neither bit is set to 1, resistance is measured.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	not	CH8	CH7	CH6	CH5	CH4	CH3	CH2	CH1							
12	used	V	V	V	V	V	V	V	V							
REG	not	CH8	CH7	CH6	CH5	CH4	CH3	CH2	CH1							
13	used	1	-	- 1	- 1	I	- 1	- 1	- 1							

Be careful to only set 1 bit per channel (so never set both register 12 and 13 to 1!), as setting the bit triggers physical connections on the module to be made. Also, setting 1 channel to the wrong input type can cause wrong values on all channels!

The type of measurement selected for each channel, is indicated with the corresponding LEDs; no LED means resistive measurement, the "I"-LED indicates the channel is measuring current, and the "V"-LED indicates the channel is measuring voltage.

Important to know, is that after a power interruption, registers 12 and 13 get reset to their default value (16#0000). This allows for the module to be "hot swapped" in any communication bus loop. The configuration is thus fully relying on the Modbus client (previously master). Note that this means that the Modbus client (previously master) is supposed to continuously verify the register values to make sure the right type of measurements are being measured by the module.

From firmware version 3.11 onwards (released August 2020):

When resistance is selected, Read/Write registers 14..21 contain the sensor type per channel. The supported sensor types for firmware version 3.11 are: 0 = pure resistance measurement, 1 = NTC10k sensor, 2 = PT1000 sensor, 3 = NTC20k sensor, 4 = Ni1000-LG sensor, and 5 = Ni1000-DIN sensor.

REG 14	Channel 1 resistive measurement type parameter (0=Ohms, 1=°C NTC10k, 2=°C PT1000, 3=°C NTC20k, 4=°C Ni1000-LG, 5=°C Ni1000-DIN)
REG 15	Channel 2 resistive measurement type parameter (0=Ohms, 1=°C NTC10k, 2=°C PT1000, 3=°C NTC20k, 4=°C Ni1000-LG, 5=°C Ni1000-DIN)

REG	Channel 8 resistive measurement type parameter
21	(0=Ohms, 1=°C NTC10k, 2=°C PT1000, 3=°C NTC20k, 4=°C Ni1000-LG, 5=°C Ni1000-DIN)

Read only registers 22..29 contain the measured value per channel. When the raw resistance value in Ohms is selected in registers 14..21, there are no decimals, and the register simply contains the value of the resistance. For temperature sensors, or when voltage or current is being measured, the measurement is multiplied by 100 (=two decimals are being used).

REG 22	Channel 1 measurement value
REG 23	Channel 2 measurement value

REG	
29	Channel 8 measurement value

From firmware version 3.11 onwards, read only register 127 contains the firmware version of the module (x100).

From firmware version 3.12 onwards: Current measurement of more than 25 mA is now shown as 25mA. Older versions overflowed to zero.



### FdxCompact AO-8-C

Read/write registers 0..7 control the output voltage of channels 1..8. Only the 10 least significant bits are used, meaning that the maximum value you can set a register to is 1023. When the channel's value is set to 1023, the channel will send out 10V. The 0..10V output value is a linear function of the 0..1023 register value.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	not	not			not	not	CH1	CH1					CH1	CH1	CH1	CH1
0	used	used			used	used	BIT10	BIT9					BIT4	BIT3	BIT2	LSB
REG	not	not			not	not	CH2	CH2					CH2	CH2	CH2	CH2
1	used	used			used	used	BIT10	BIT9					BIT4	BIT3	BIT2	LSB
								•						•		

REG CH8 CH8 not not not not CH8 CH8 CH8 CH8 used used used used BIT10 BIT4 BIT9 BIT3 BIT2 LSB

Read/write registers 9..16 contain the pre-set values for channels 1..8 and 1 bit to indicate whether or not that value is used when the module has not received any Modbus messages for more than 120 seconds.

If the bit is not set, the corresponding channel's output will continue to send out the same voltage level as the last received value in the channel's corresponding register. When the bit is set to 1, the channel's output voltage will be set to the value (0..1023) from bits 1..10.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH1	not			not	not	CH1	CH1					CH1	CH1	CH1	CH1
9	default	used			used	used	default	default					default	default	default	default
	used						BIT10	BIT9					BIT4	BIT3	BIT2	LSB
REG	CH2	not			not	not	CH2	CH2					CH2	CH2	CH2	CH2
10	default	used			used	used	default	default					default	default	default	default
	used						BIT10	BIT9					BIT4	BIT3	BIT2	LSB

REG	CH8	not		not	not	CH8	CH8			CH8	CH8	CH8	CH8
16	default	used		used	used	default	default			default	default	default	default
	used					BIT10	BIT9			BIT4	BIT3	BIT2	LSB



#### FdxCompact DI-16-C

Read only register 0 contain the current status of inputs 1..16, where a 1 means the channel is not active (loop is open), and a 0 means the channel is active (loop closed).

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH16	CH15	CH14											CH3	CH2	CH1
0	status	status	status											status	status	status

Read/write registers 1 and 2 determine for each channel whether the corresponding LED indicator is locally controlled or by the remote Modbus master. Just like the measurement type registers for the FdxCompact Al-8-C module, make sure only 1 of these registers has the corresponding bit set for each channel. If neither bit is set, the channel works with local LED control. The bits in register 1 should be set to 1 for the channels that have their LEDs controlled by the Modbus master, the bits in register 2 for those channels that the Dl-16-C module will control itself (local).

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH16	CH15	CH14											CH3	CH3	CH1
1	master LEDctrl	master LEDctrl	master LEDctrl											master LEDctrl	master LEDctrl	master LEDctrl
REG 2	CH16 local LEDctrl	CH15 local LEDctrl	CH14 local LEDctrl											CH3 local LEDctrl	CH2 local LEDctrl	CH1 local LEDctrl

Read/write registers 3 and 4 determine for each channel the colour of the LED when the channel is active (the loop is closed). The bits in register 3 should be set to 1 for the channels that will have their LEDs light up red, and those of register 4 for those channels that will have their LEDs light up green.

Note that when on local control, the LED will always be green when the loop for the according channel is closed. When the received impulse is longer than 2 seconds and the "red LED" bit is set, the LED will be red for two seconds when the loop is cut, before the LED goes off completely, indicating the opened loop for that channel.

Here also, make sure to only set the bit in 1 of the 2 registers at a time!

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH16	CH15	CH14											CH3	CH2	CH1
4	red	red	red											red	red	red
REG	CH16	CH15	CH14											CH3	CH2	CH1
5	green	green	green											green	green	green

Read/write register 5 contains the blinking status of each channel's LED. This is independent of the LED being controlled locally or from the Modbus master. Whenever the corresponding LED is on, it will blink if the bit is set to 1.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH16	CH15	CH14											CH3	CH2	CH1
5	blink	blink	blink											blink	blink	blink

Read/write registers 6..13 contain the required minimum pulse width for channels 1..16. All pulses shorter than set in these registers are discarded. The pulse width is measured in both rising and falling edges of the pulse. Per register, 2 channels' minimum pulse width is defined. The 1-byte value per channel is multiplied by 5 ms to get the actual minimum pulse width, meaning that these can be defined between 5..1275 ms.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH2	CH2					CH2	CH2	CH1	CH1					CH1	CH1
6	MPW	MPW					MPW	MPW	MPW	MPW					MPW	MPW
	BIT8	BIT8					BIT2	BIT1	BIT8	BIT7					BIT2	BIT1
REG	CH4	CH4					CH4	CH4	CH3	CH3					CH3	CH3
7	MPW	MPW					MPW	MPW	MPW	MPW					MPW	MPW
	BIT8	BIT8					BIT2	BIT1	BIT8	BIT7					BIT2	BIT1

REG CH16 CH16 CH16 CH16 CH15 CH15 CH15 CH15 MPW **MPW** MPW MPW MPW **MPW** MPW **MPW** 13 BIT8 BIT8 BIT2 BIT1 BIT8 BIT7 BIT2 BIT1



Read/write registers 14..29 contain the number of pulses longer than the minimum pulse width detected for channels 1..16. Pulses shorter than the minimum pulse width defined in registers 6..13. Since the registers are 16-bit values, each counter will reset to 0 after 65535 pulses.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH1	CH1	CH1											CH1	CH1	CH1
14	counter	counter	counter											counter	counter	counter
	MSB	BIT15	BIT14											BIT3	BIT2	LSB
REG	CH2	CH2	CH2											CH2	CH2	CH2
15	counter	counter	counter											counter	counter	counter
	MSB	BIT15	BIT14											BIT3	BIT2	LSB
REG	CH16	CH16	CH16											CH16	CH16	CH16
29	counter	counter	counter											counter	counter	counter
	MSB	BIT15	BIT14											BIT3	BIT2	LSB

From firmware version 3.11 onwards (released August 2020), registers 31..46 contain the tachopulse counter value. The tachopulse should be of the open collector type. If the pulse is of the sinking type, the tachopulse can be connected to the short-circuited input on the DI-16-C module. The reading range is 10..15000 rpm.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH1	CH1	CH1											CH1	CH1	CH1
31	pulse	pulse	pulse											pulse	pulse	pulse
	speed	speed	speed											speed	speed	speed
	MSB	BIT15	BIT14											BIT3	BIT2	LSB
REG	CH2	CH2	CH2											CH2	CH2	CH2
32	pulse	pulse	pulse											pulse	pulse	pulse
	speed	speed	speed											speed	speed	speed
	MSB	BIT15	BIT14											BIT3	BIT2	LSB
REG	CH16	CH16	CH16											CH16	CH16	CH16
46	pulse	pulse	pulse											pulse	pulse	pulse
	speed	speed	speed											speed	speed	speed
	MSB	BIT15	BIT14											BIT3	BIT2	LSB



### FdxCompact DO-8-C

Read/write register 0 contains the values of outputs (relays) 1..8. 1 means the relay is active, 0 for an inactive relay.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	not						not	not	CH8						CH2	CH1
0	used						used	used	status						status	status

Read/write register 1 contains the pre-set values for channels 1..8 (in bits 1..8), and 1 bit per channel (bits 9..16) to indicate whether or not that value is used after the module has not received any Modbus messages for more than 30 seconds (or for the number of seconds defined in register 3). If the pre-set value is not to be used (bit at zero), the old value stays after a communication fallout.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG 1	CH8 default used						CH2 default used	CH1 default used	CH8 default						CH2 default	CH1 default

Read/write register 3 contains the "communication failure timeout" value in seconds. This is the number of seconds after which the values defined in register 1 will be applied to the relays. The value can be set to any value between 30 and 120.

Read/write register 4 contains the value (in seconds) after which the watchdog functionality will be deployed. The watchdog works as follows: if the value of register 4 is zero, the watchdog is disabled (as it is by default). Setting a value bigger than 120 will activate the watchdog functionality; if the module has not received any Modbus messages for the number of seconds specified in register 4, (either for the module itself, or even messages for other devices on the network,) the module will activate relay number 8 for 2 seconds. Note that even if the module itself is not polled, but there is Modbus master activity on the network, the watchdog will NOT "bark". The Modbus master's power supply should be connected through the Normally Closed (NC) connector of this channel 8, causing the controller to reboot when the relay is activated. The expectation is that causing the Modbus master to reboot, will also restart the Modbus communication.

**NOTE:** Although this feature is implemented into the firmware of the DO-8-C module, no controller should ever be powered directly through the relays of the module! The feature is merely there for legacy reasons.

Register 5 contains the number of times the Watchdog has "barked", meaning the number of times it has cut off power to the controller.



### FdxCompact DOOC-16-C

Read/write register 0 contains the values of outputs (relays) 1..8. 1 means the relay is active, 0 for an inactive relay.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH16														CH2	CH1
0	status														status	status

Read/write register 1 contains the pre-set values for channels 1..8 (in bits 1..8), and 1 bit per channel (bits 9..16) to indicate whether or not that value is used after the module has not received any Modbus messages for more than 30 seconds (or for the number of seconds defined in register 3). If the pre-set value is not to be used (bit at zero), the old value stays after a communication fallout.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH8						CH2	CH1	CH8						CH2	CH1
1	default						default	default	default						default	default
	used						used	used								

Read/write register 3 contains the "communication failure timeout" value in seconds. This is the number of seconds after which the values defined in register 1 will be applied to the relays. The value can be set to any value between 30 and 120.

Read/write register 4 contains the value (in seconds) after which the watchdog functionality will be deployed. The watchdog works as follows: if the value of register 4 is zero, the watchdog is disabled (as it is by default). Setting a value bigger than 120 will activate the watchdog functionality; if the module has not received any Modbus messages for the number of seconds specified in register 4, (either for the module itself, or even messages for other devices on the network,) the module will activate relay number 8 for 2 seconds. Note that even if the module itself is not polled, but there is Modbus master activity on the network, the watchdog will NOT "bark". The Modbus master's power supply should be connected through a help relay connected to channel 8, causing the controller to reboot when the relay is activated. The expectation is that causing the Modbus master to reboot, will also restart the Modbus communication. NOTE: Although this feature is implemented into the firmware of the DOOC-16-C module, no controller should ever be powered directly through an open collector relay! The feature is merely there for legacy reasons.

Register 5 contains the number of times the Watchdog has "barked", meaning the number of times it has cut off power to the controller.

Read/write register 6 contains the pre-set values for channels 9..16 (in bits 1..8), and 1 bit per channel (bits 9..16) to indicate whether or not that value is used after the module has not received any Modbus messages for more than 30 seconds (or for the number of seconds defined in register 3). If the pre-set value is not to be used (bit at zero), the old value stays after a communication fallout.

BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	CH16						CH10	CH9	CH16						CH10	CH9
6	default						default	default	default						default	default
	used						used	used								



### FdxCompact TRIAC-8-C

used used

Read/write registers 0..7 control the output voltage of channels 1..8. Only the 10 least significant bits are used, meaning that the maximum value you can set a register to is 1023. Each channel is activated for a percentage of the cycle time of approximately 1 second. Each cycle, all channels are first activated (that is, as long as the channel's value is not zero), and stay active for the time defined in the channel's register.

The time a channel's output stays active for, is a linear function of the 0..1023 register value.

used used

A value of 256 will have the channel's output active for +/- 250 mses, a value of 512 for +/- half a second, etc.

BH	16	15	14	13	12	11	10	9	8	/	6	5	4	3	2	1
REG	not	not			not	not	CH1	CH1					CH1	CH1	CH1	CH1
0	used	used			used	used	BIT10	BIT9					BIT4	BIT3	BIT2	LSB
REG	not	not			not	not	CH2	CH2					CH2	CH2	CH2	CH2
1	used	used			used	used	BIT10	BIT9					BIT4	BIT3	BIT2	LSB
REG	not	not			not	not	CH8	CH8					CH8	CH8	CH8	CH8

Read/write registers 9..16 contain the pre-set values for channels 1..8 and 1 bit to indicate whether or not that value is used when the module has not received any Modbus messages for more than 120 seconds.

BIT10 BIT9

If the bit is not set, the corresponding channel's output will continue to be active for the percentage of time defined in the last received value in the channel's corresponding register. When the bit is set to 1, the channel's output value will be set to the value (0..1023) from bits 1..10.

BIT	16	15	14	13	12	11	10	9	ω	7	6	5	4	3	2	1
REG	CH1	not			not	not	CH1	CH1					CH1	CH1	CH1	CH1
9	default	used			used	used	default	default					default	default	default	default
	used						BIT10	BIT9					BIT4	BIT3	BIT2	LSB
REG	CH2	not			not	not	CH2	CH2					CH2	CH2	CH2	CH2
10	default	used			used	used	default	default					default	default	default	default
	used						BIT10	BIT9					BIT4	BIT3	BIT2	LSB

REG	CH8	not		not	not	CH8	CH8			CH8	CH8	CH8	CH8
16	default	used		used	used	default	default			default	default	default	default
	used					BIT10	BIT9			BIT4	BIT3	BIT2	LSB

From firmware version 3.11 onwards, read only register 127 contains the firmware version of the module (x100).

From firmware version 3.13 onwards, read/write register 18 contains a slowdown multiplier for the cycle time that is used to send out the signals: in default settings, the 0..1023 value that is set to registers 0..7 is an expression of milliseconds (approximatively). The value of register 18 is used to multiply that time. The maximum allowed value is 9000, meaning that the longest possible cycle time is +/- 150 minutes.


E.g. with register 18 set to 3600, a value of 100 in registers 0...7 means the outputs are active for about 6 minutes, and then inactive again for roughly 54 minutes.

From firmware version 3.14 onwards, read/write register 19 contains inverter bits for each channel. Setting the bit will make the output a "normally closed" output (0=Normally Open Output (default), 1=Normally Closed Output).


BIT	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1
REG	not	not					not	not	CH8	CH7	CH6	CH5	CH4	CH3	CH2	CH1
19	used	used					used	used	INV							






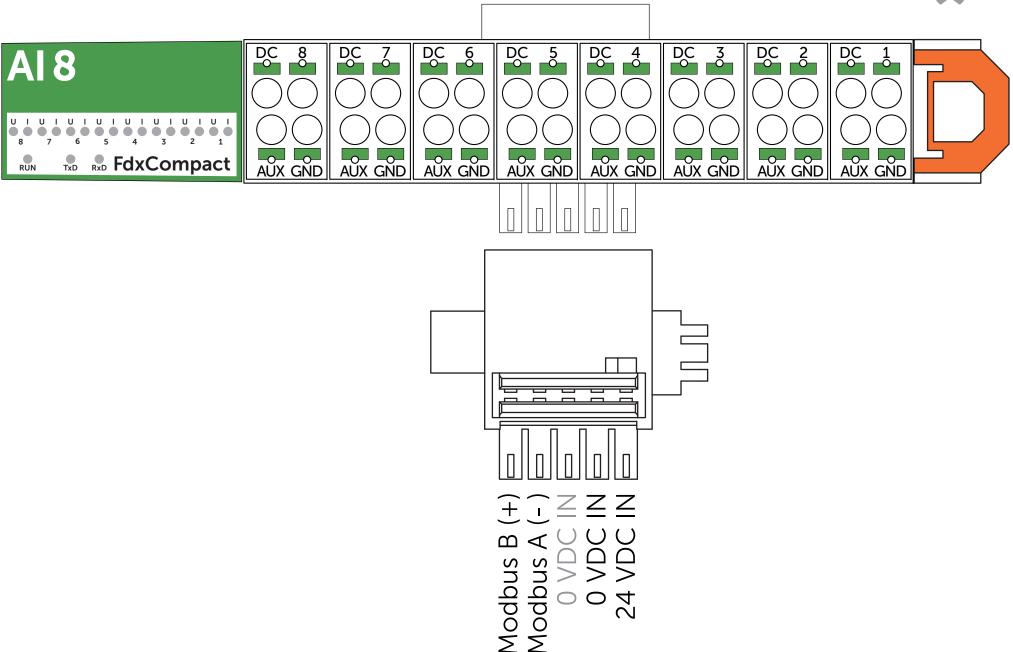




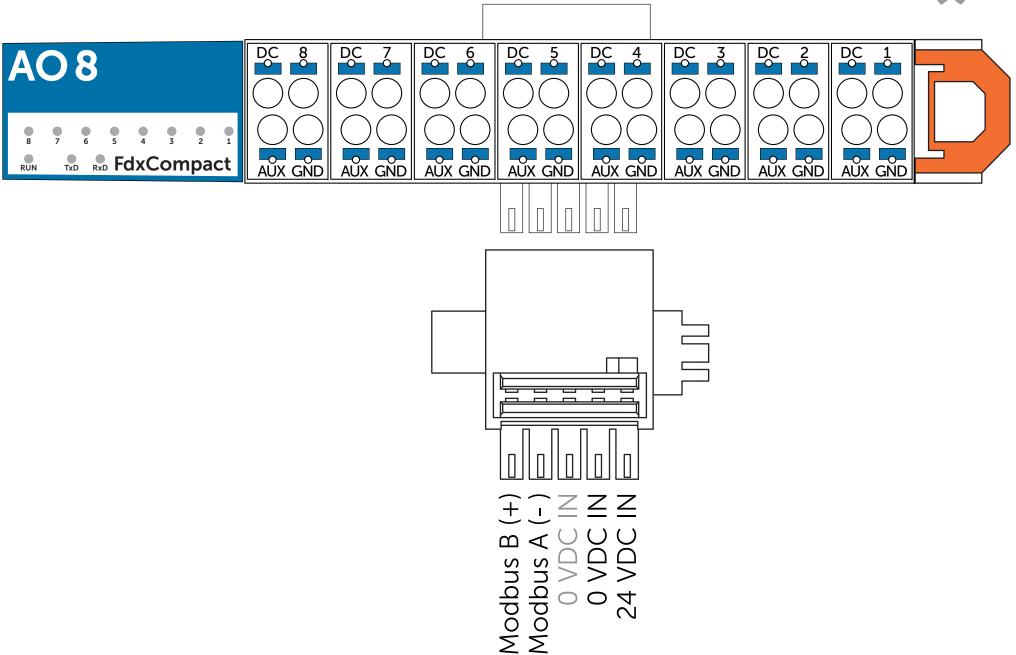




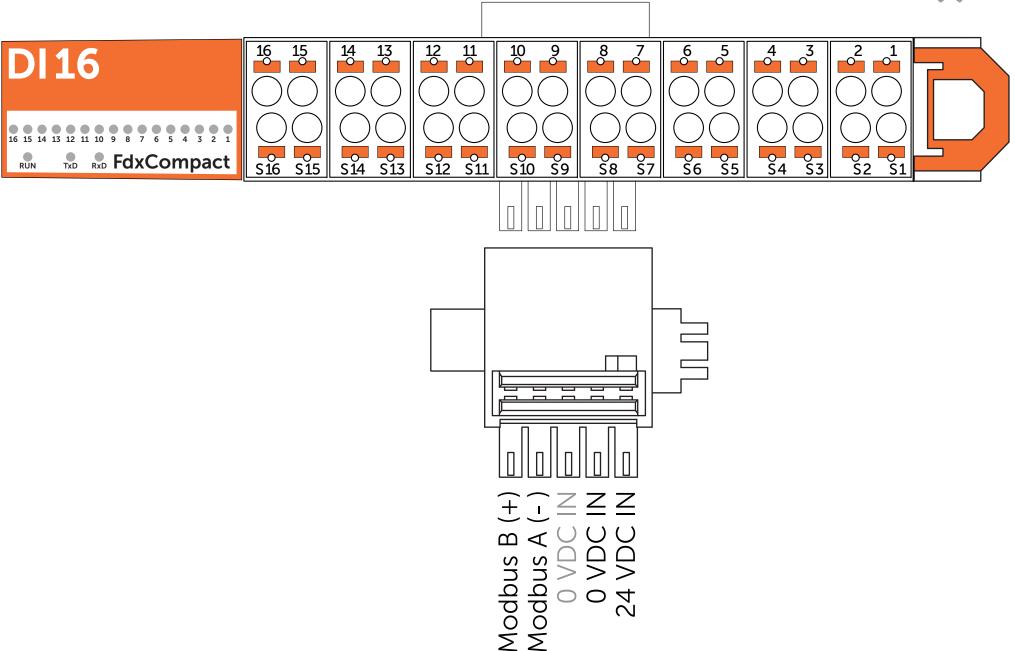




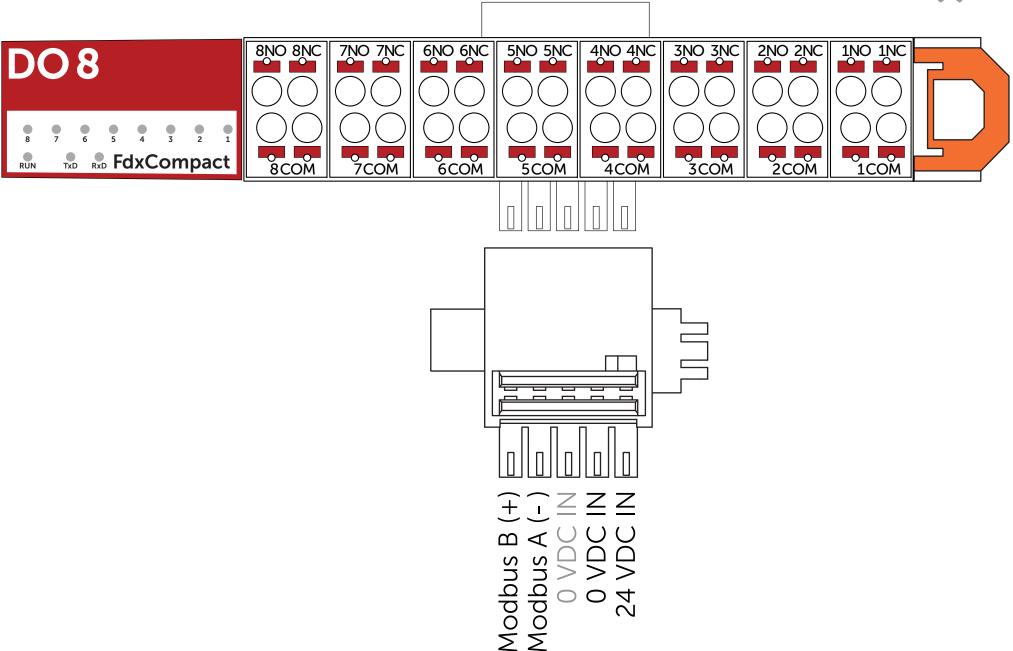



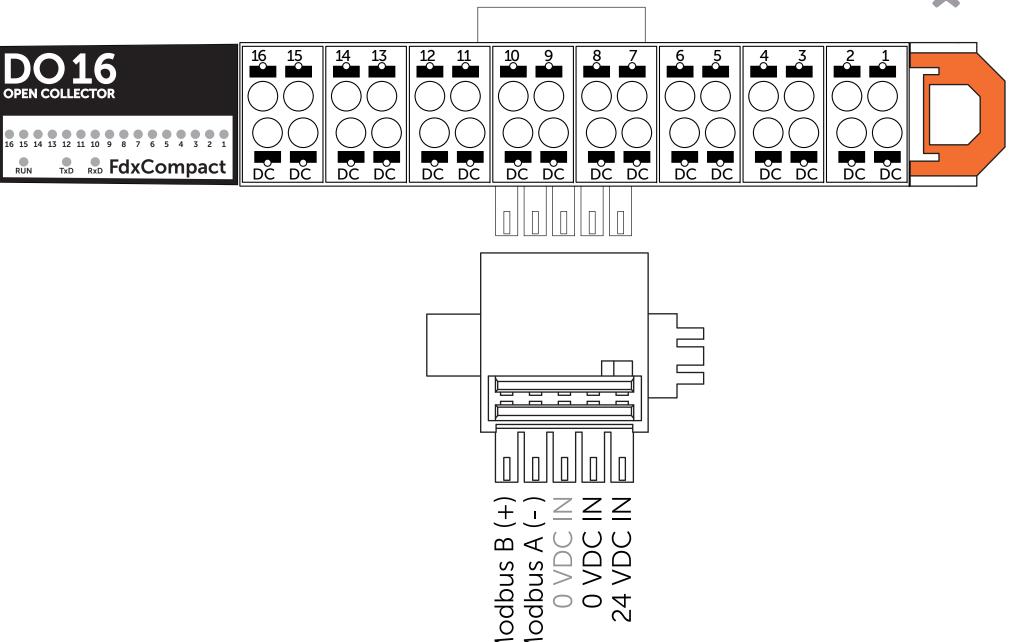




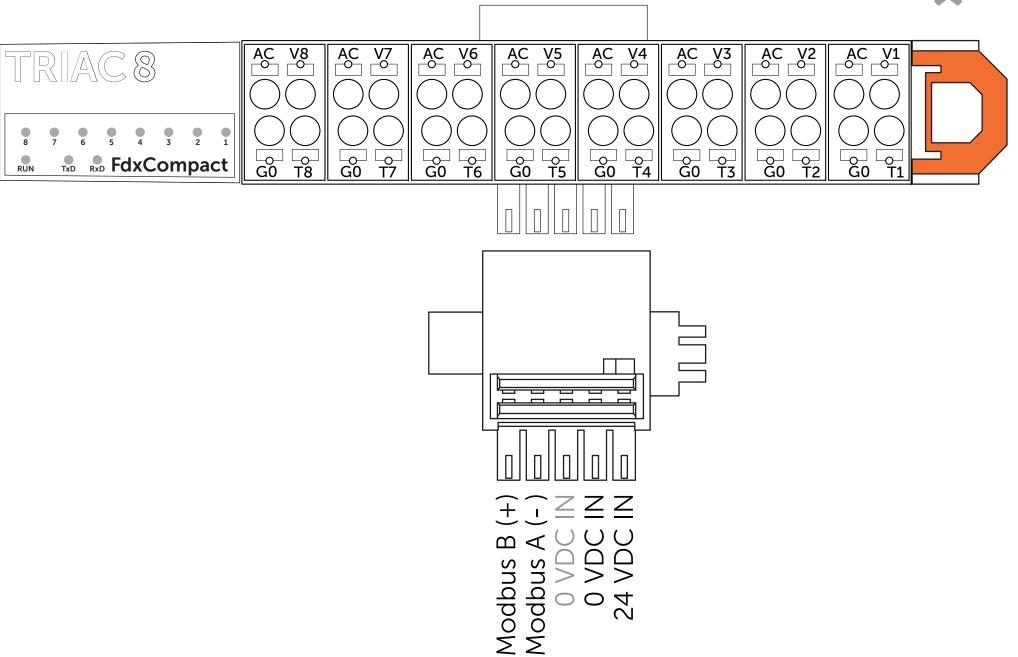




# AI-8-C module's internal wiring and logic setup

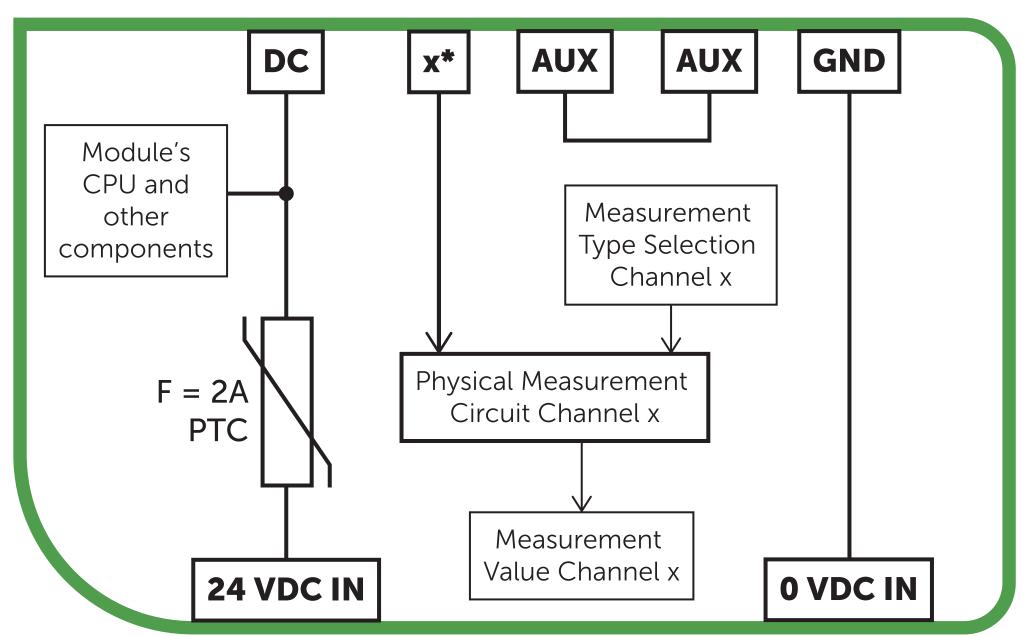




# AO-8-C module's internal wiring and logic setup

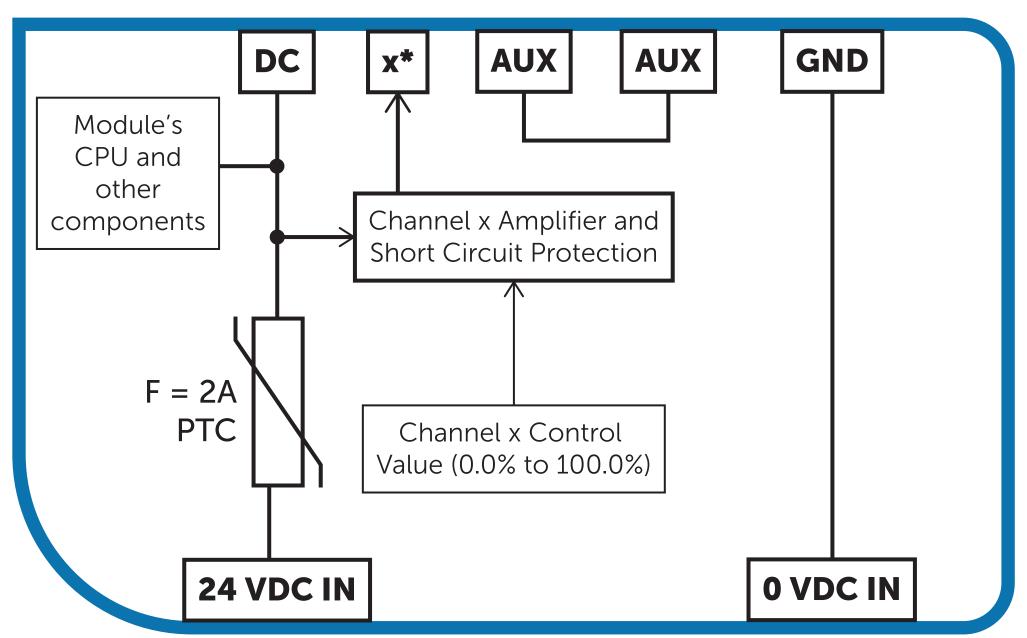




## DI-16-C module's internal wiring and logic setup

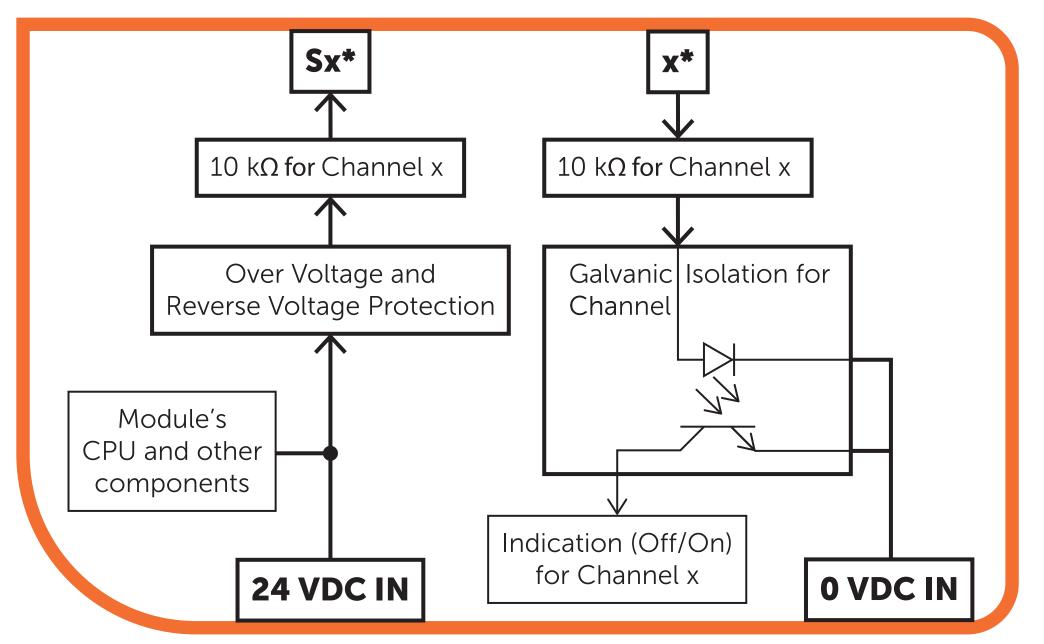




## DO-8-C module's internal wiring and logic setup

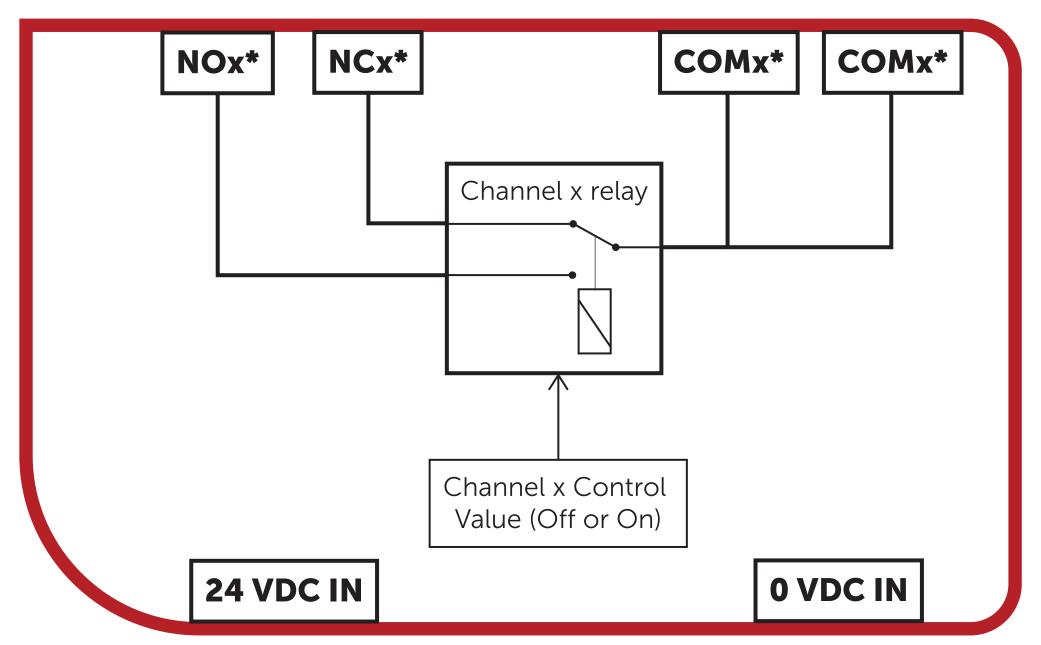


# DOOC-16-C module's internal wiring and logic setup

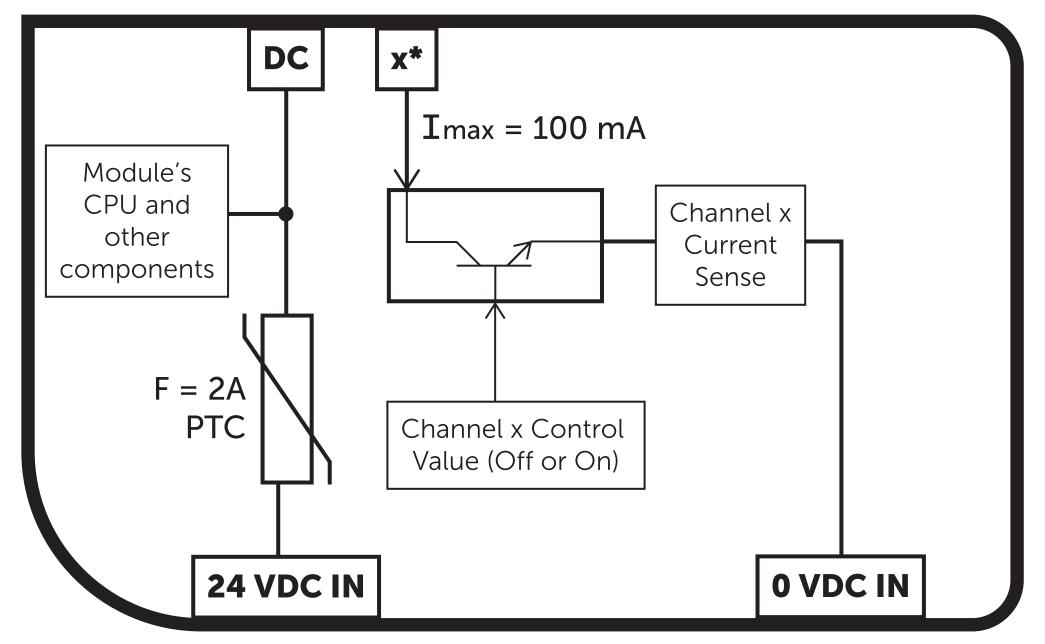




## TRIAC-8-C module's internal wiring and logic setup

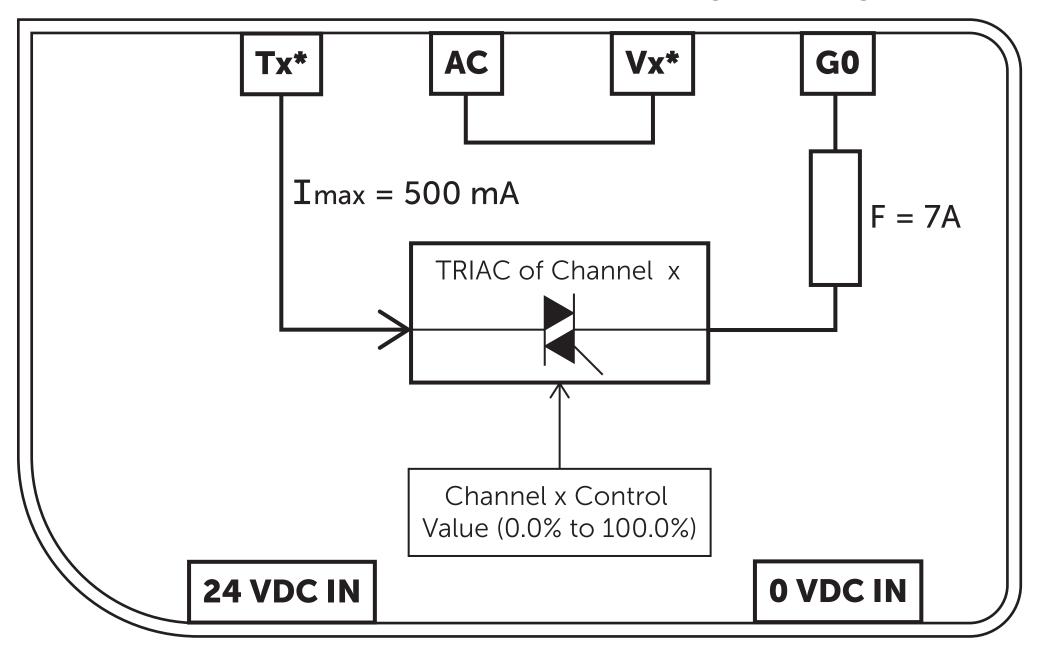




## AI-8-C resistive sensor connection

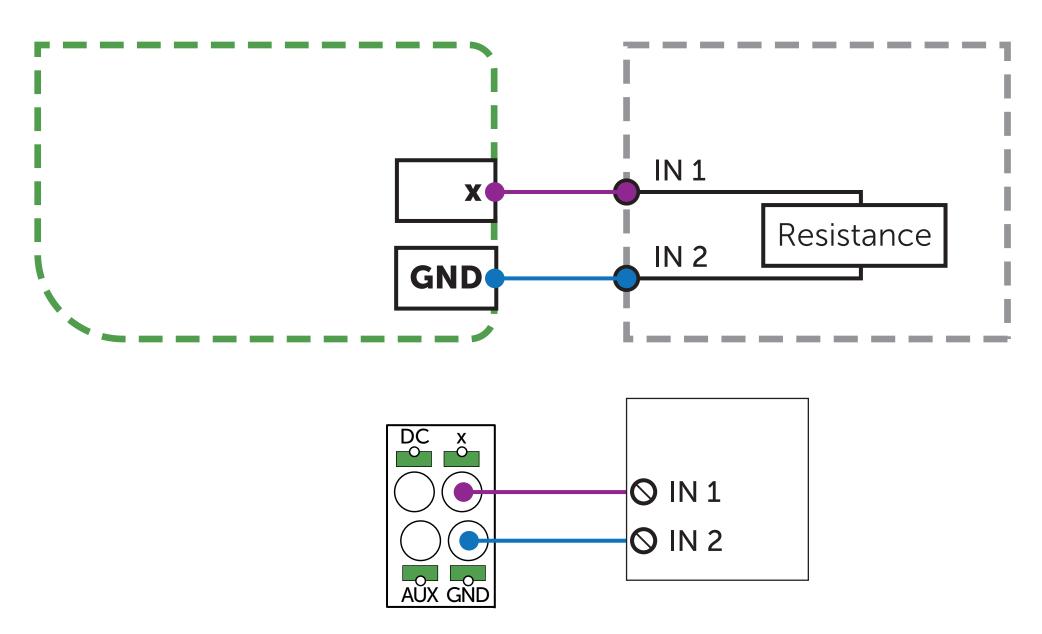



# Passive measurement inputs (resistance; 0.. $1M\Omega$ )



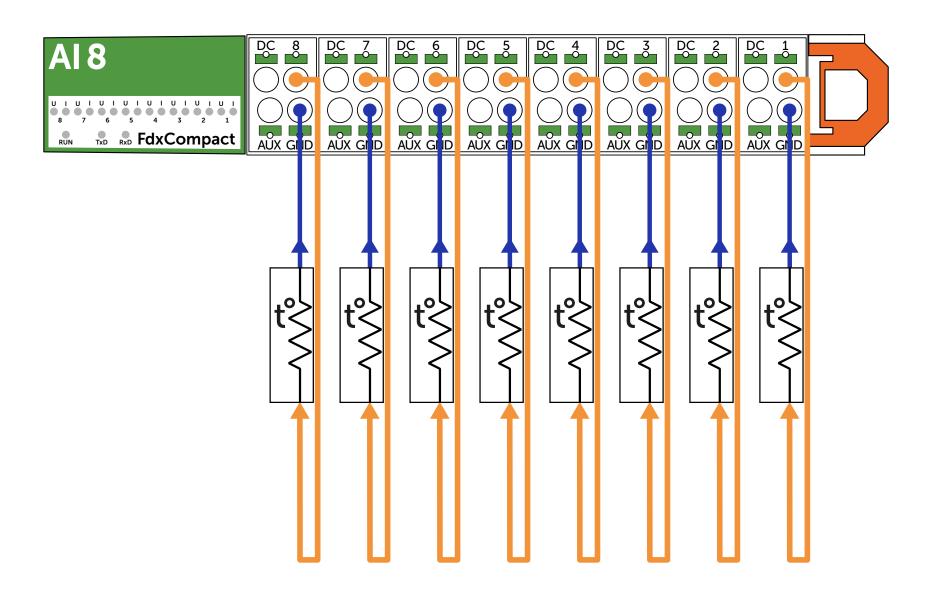


### AI-8-C voltage or current emitting sensor connection



Field device powered directly from the module

supply, make sure to not draw more than 2A.

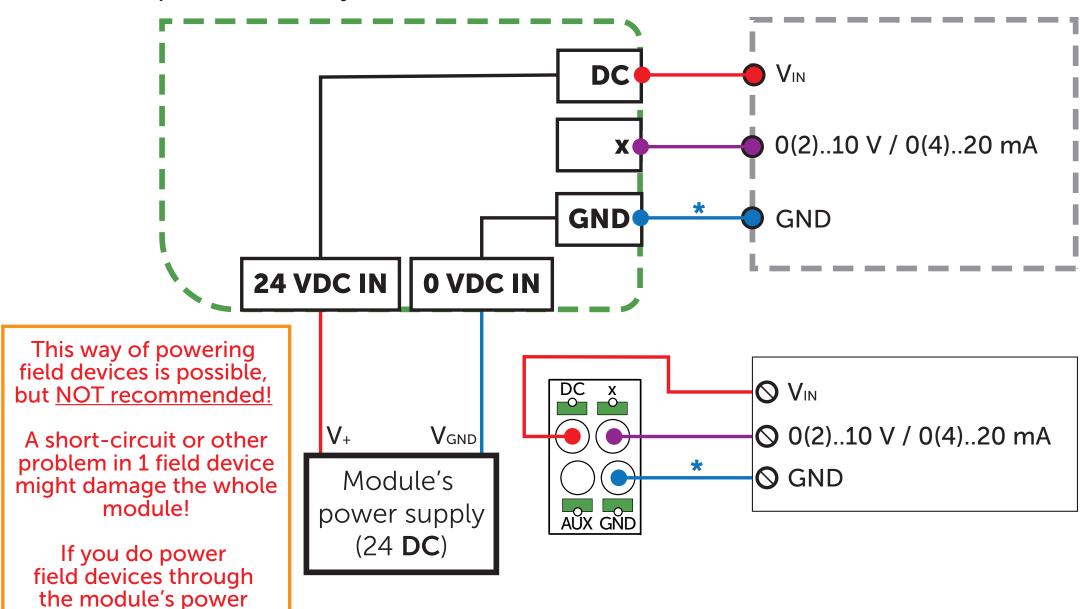


\* GND connection is not used for 2-wire current sensors

## AI-8-C voltage or current emitting sensor connection




Field device powered through the module, using the Auxiliary connectors

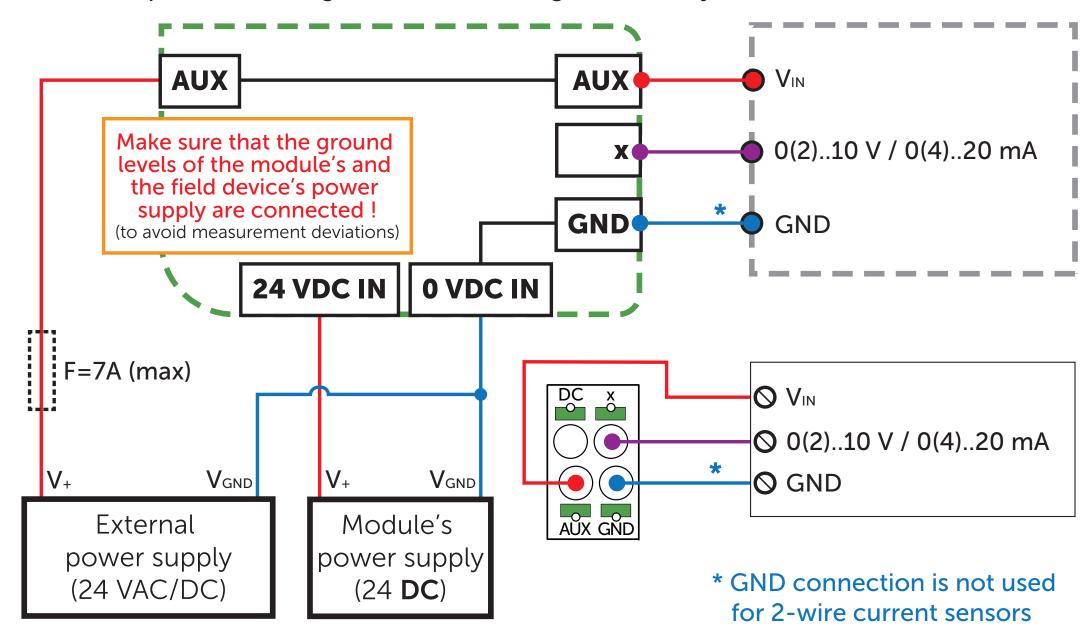

### AI-8-C voltage or current emitting sensor connection



Field device powered from an external power supply (This is the recommended way!)

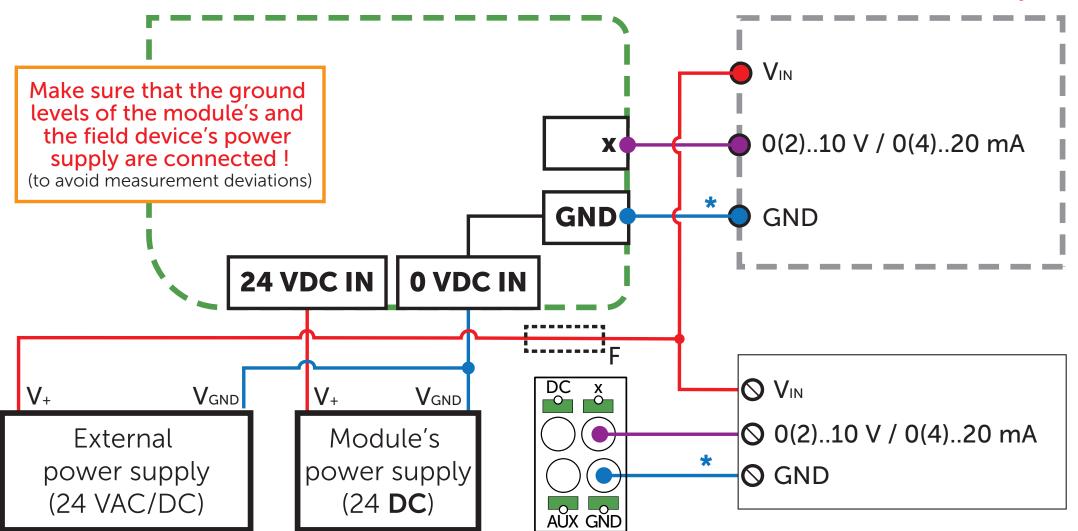


<sup>\*</sup> The GND connection can also be made from the external power supply straight to the field device, and not through the module. In this case it is very important to connect both power supply's output ground level to each other. We recommend however to use the module's GND connector, to avoid mistakes and ending up with having two different GND levels on module and field devices.

<sup>\*</sup> GND connection is not used for 2-wire current sensors




# Active measurement inputs 0..20 mA / 0..10VV




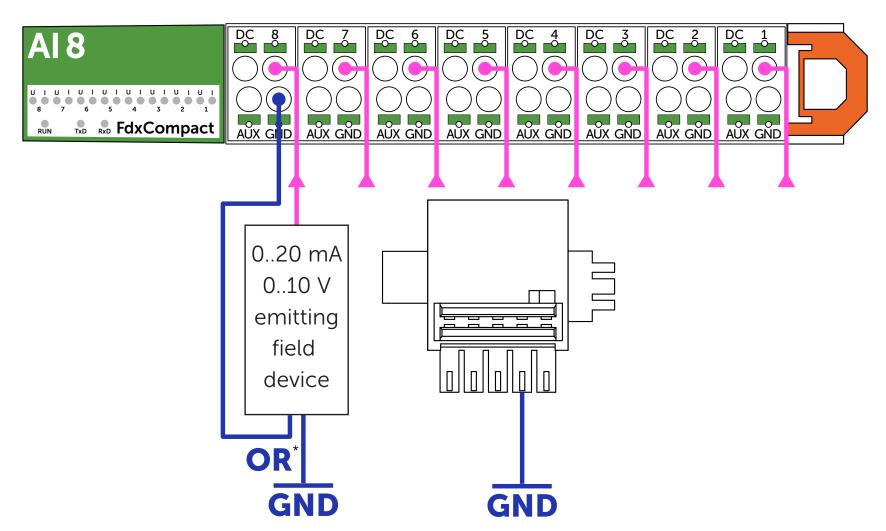

- \* Connect the GND of the power supply of the field devices either
- to the same GND as the module's power supply's GND,
- or to the GND connectors on the module

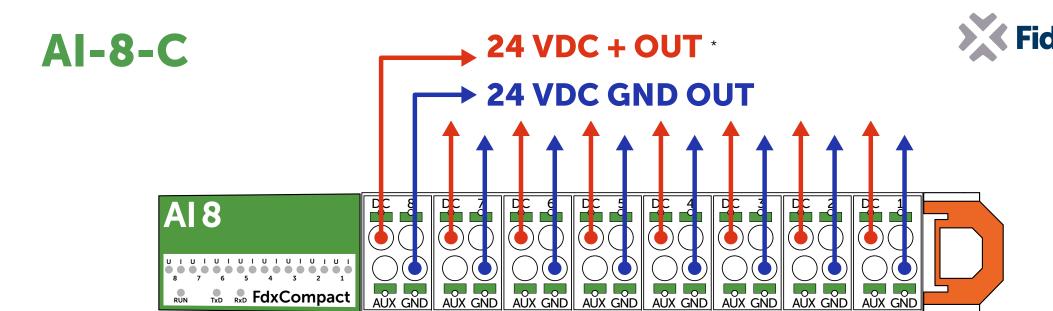

**AŬX GŇD** 

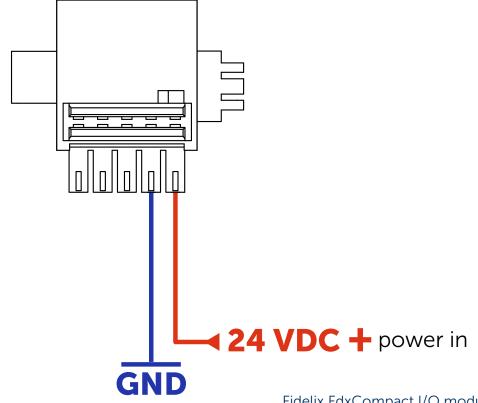


AŬX GŇD

**AŬX GŇD** 

<sup>\*</sup> can be used for field devices with reservations






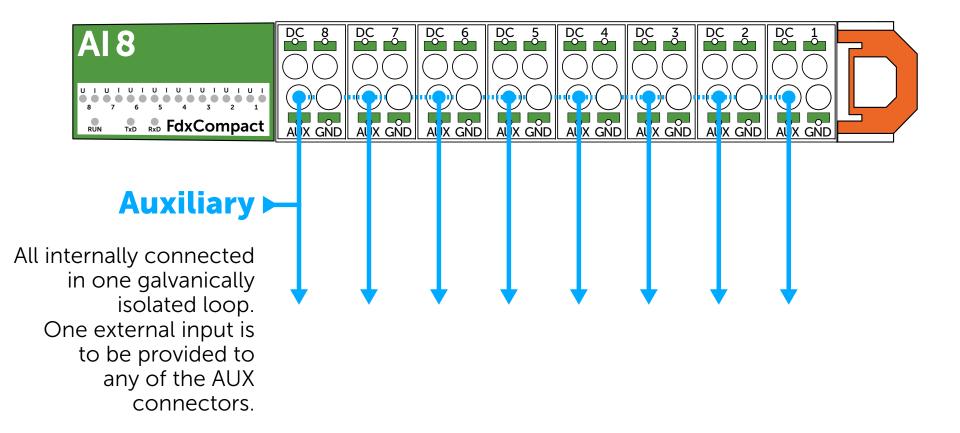

### AO-8-C 0..10 V signal (maximum 20 mA/channel)



Field device powered directly from the module

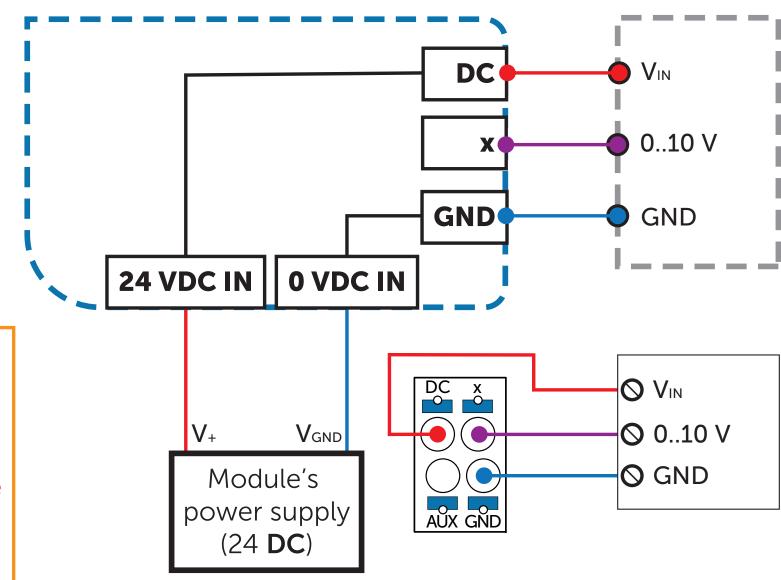

This way of powering field devices is possible, but NOT recommended!

A short-circuit or other problem in 1 field device might damage the whole module!

If you do power field devices through the module's power supply, make sure to not draw more than 2A.


### AO-8-C 0..10 V signal (maximum 20 mA/channel)



Field device powered through the module, using the Auxiliary connectors

Make sure that the ground levels of the module's and the field device's power supply are connected!


(to avoid control signal deviations)

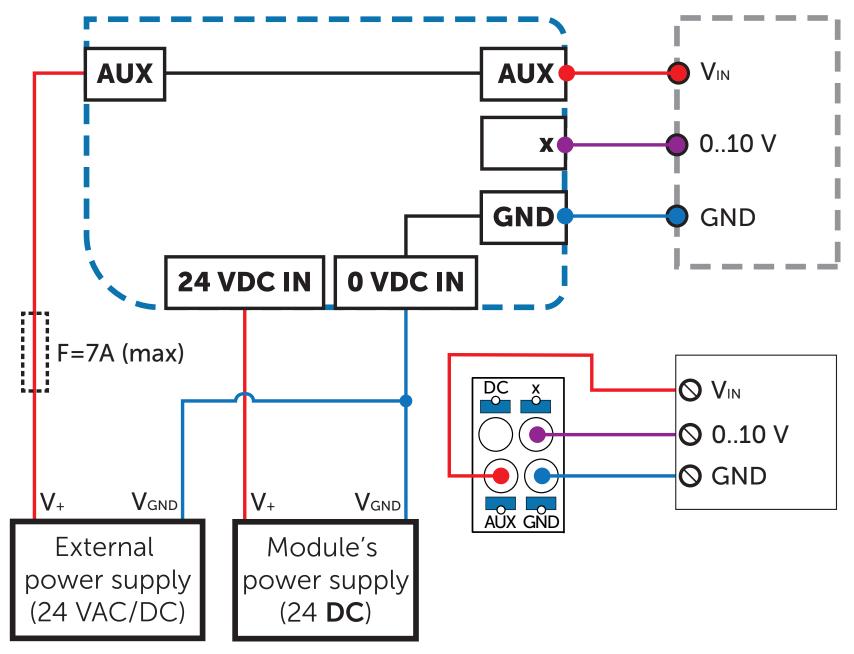

# AO-8-C 0..10 V signal (maximum 20 mA/channel)




Field device powered from an external power supply (This is the recommended way!)

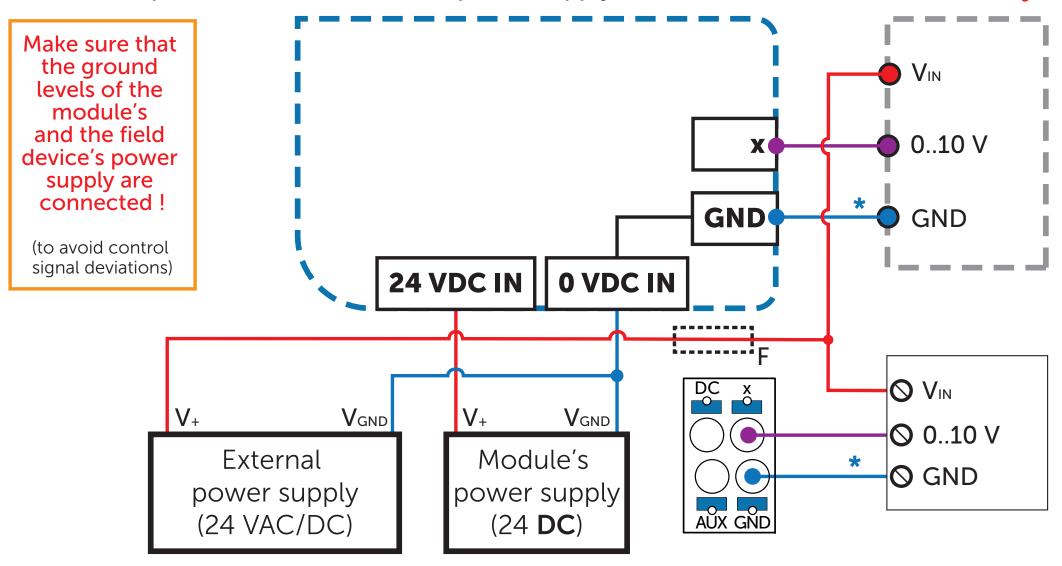


<sup>\*</sup> The GND connection can also be made from the external power supply straight to the field device, and not through the module. In this case it is very important to connect both power supply's output ground level to each other. We recommend however to use the module's GND connector, to avoid mistakes and ending up with having two different GND levels on module and field devices.


#### 0..10 V control signal output



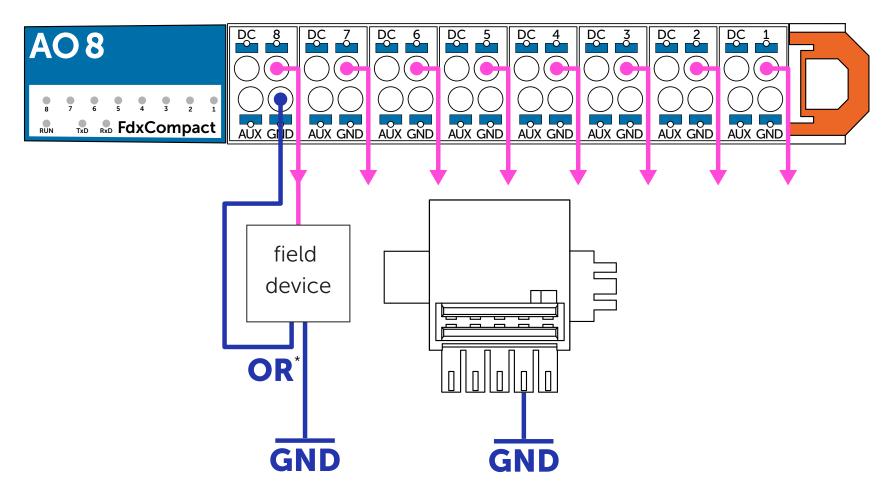

- \* Connect the GND of the power supply of the field devices, or of the control signal's connectors of the field devices, either
- to the same GND as the module's power supply's GND,
- or to the GND connectors on the module

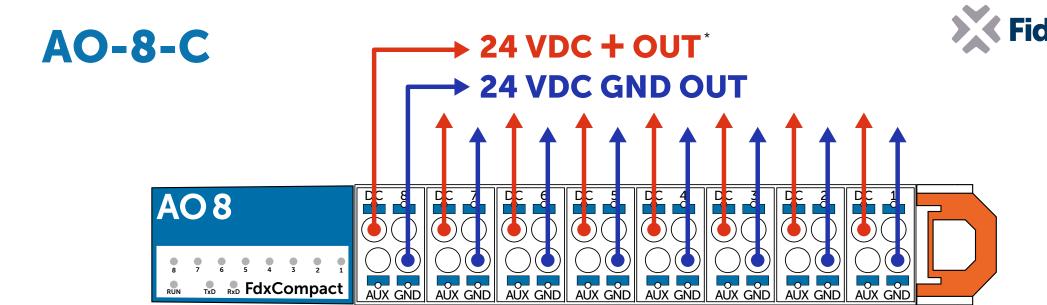


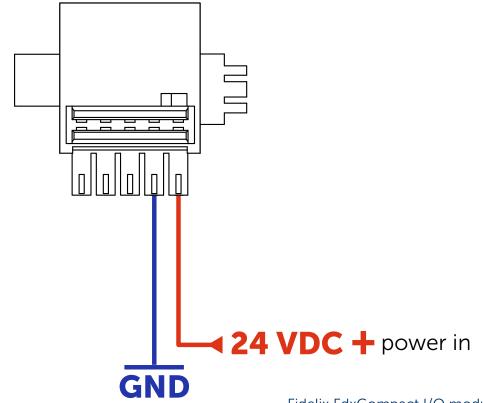

<sup>\*</sup> can be used for field devices with reservations


## AO-8-C



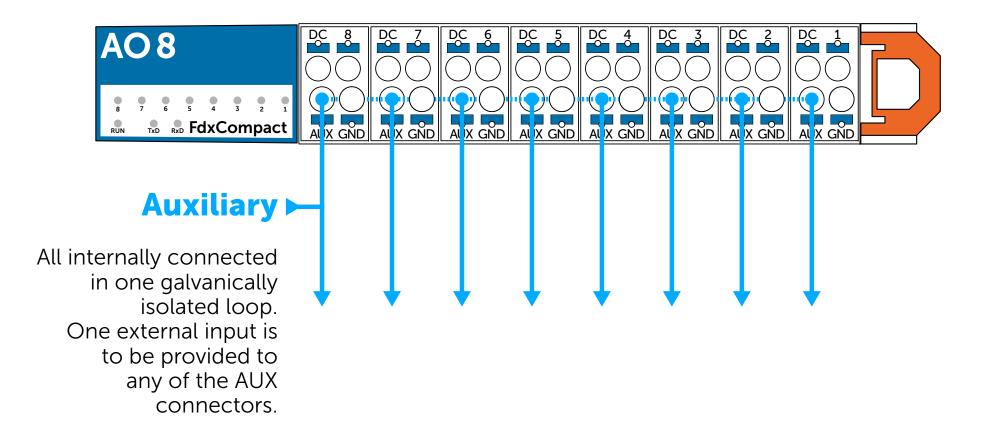




# DI-16-C reading a potential free contact (e.g. relay)

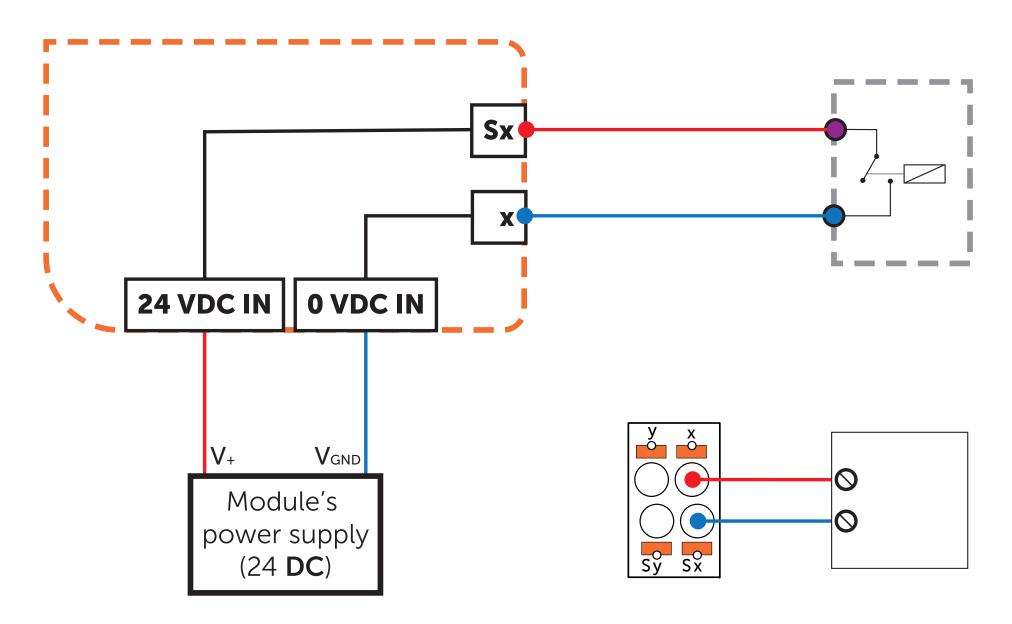




# DI-16-C Reading a passive Open Collector Output

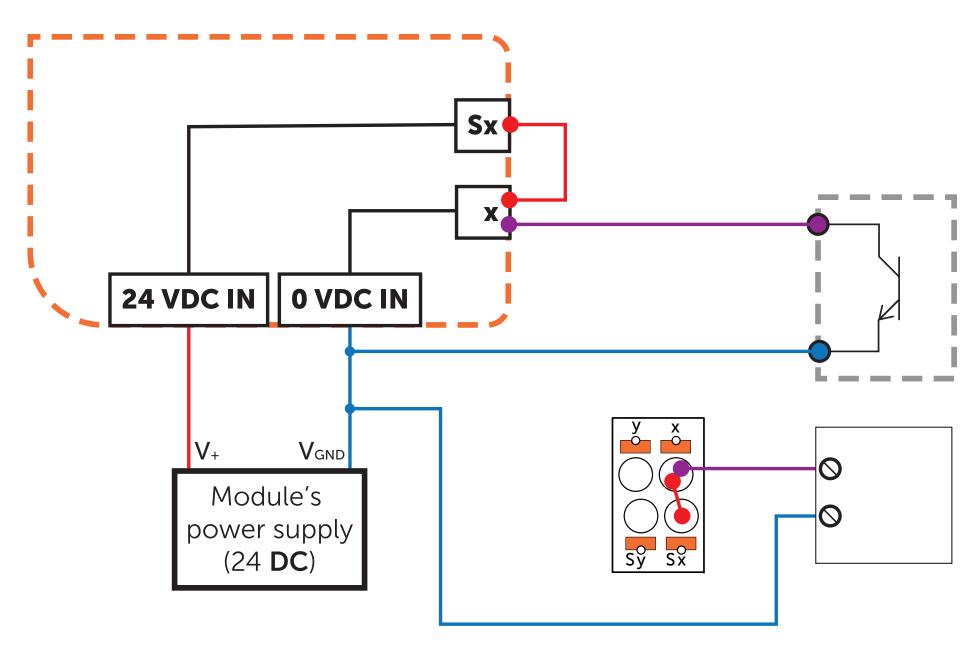

## **DI-16-C**




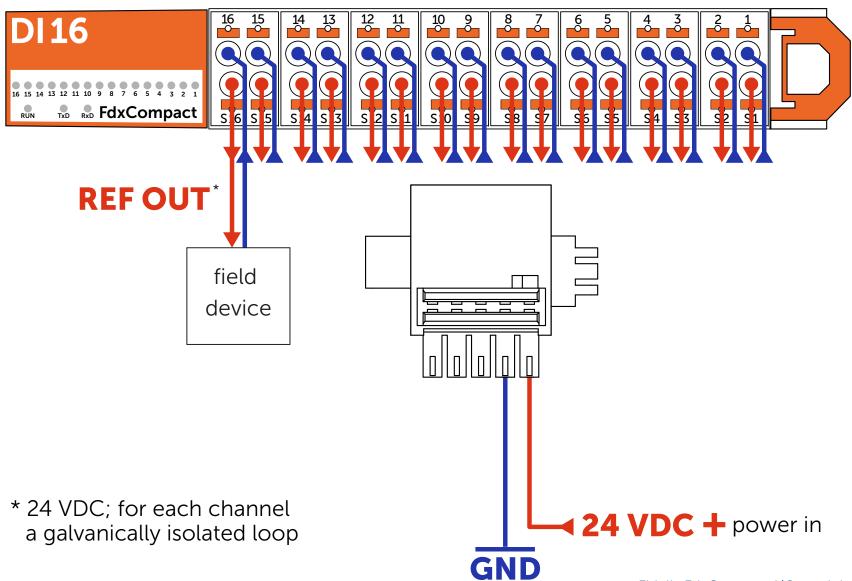

#### Tacho pulse / NPN signal




## **DI-16-C**

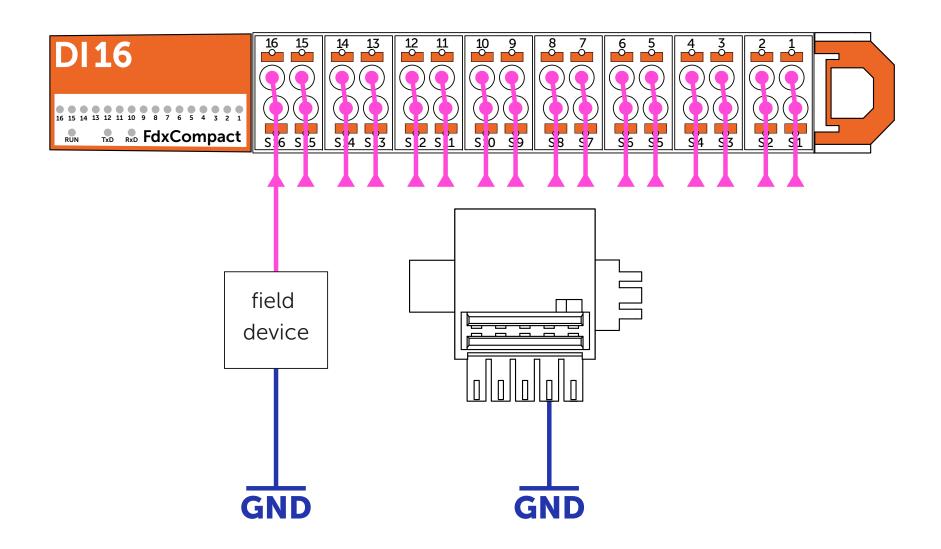

## DO-8-C Off/On control for field device



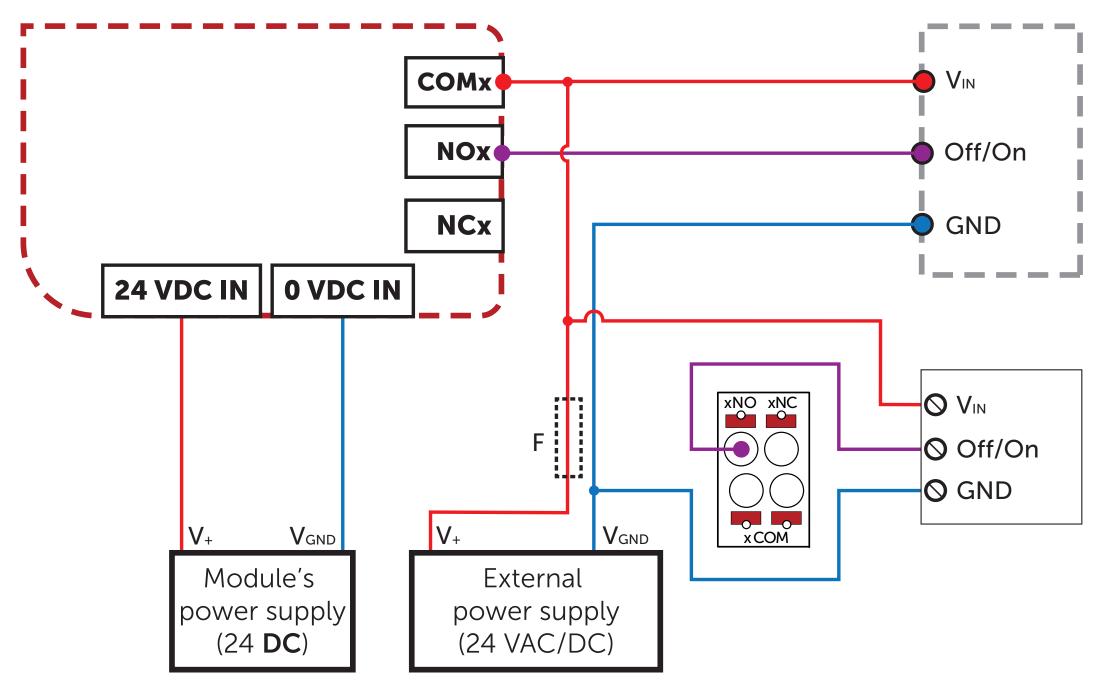











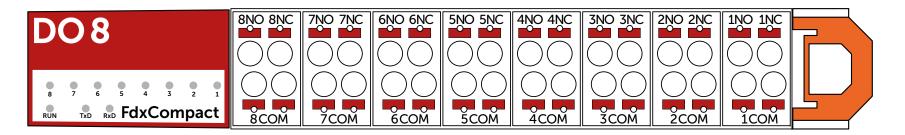


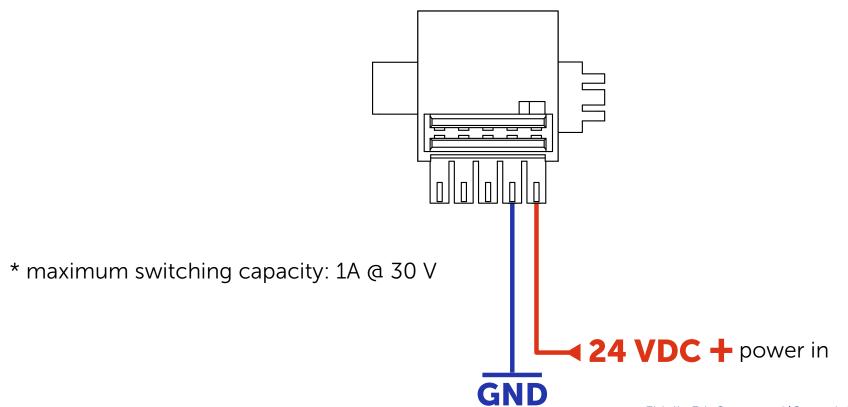






#### **Normally Open connections**

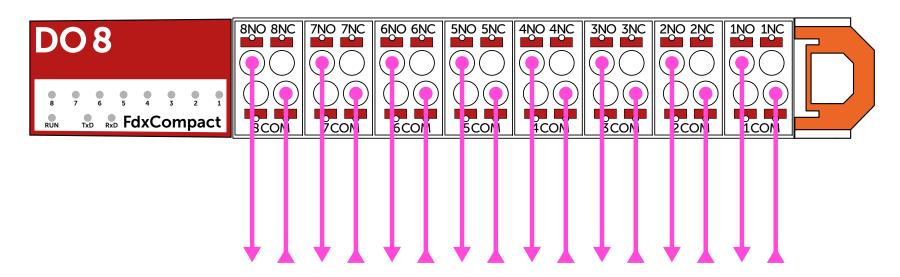


#### **Normally Closed connections**

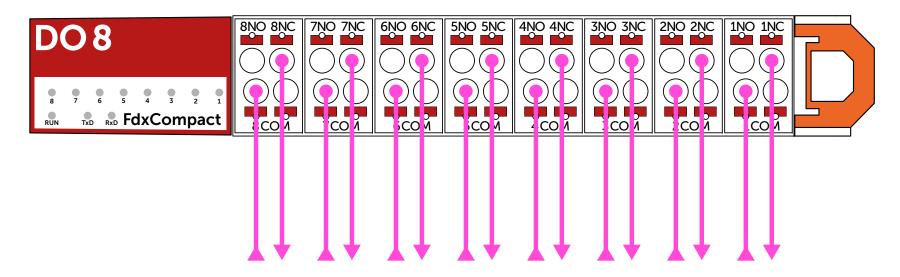






# Each set of two xCOM-connectors is internally connected to each other

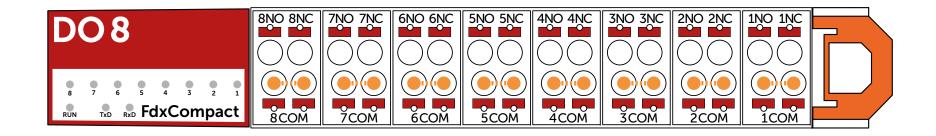


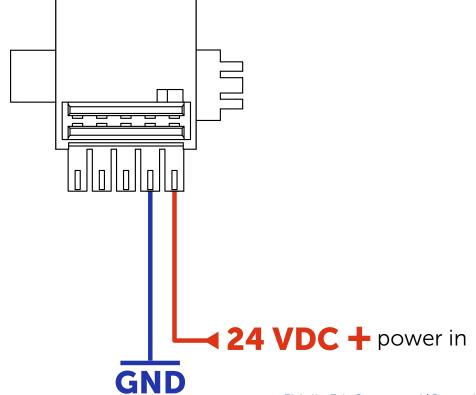

### DOOC-16-C Load connection



Operating voltage from the module's DC-connectors

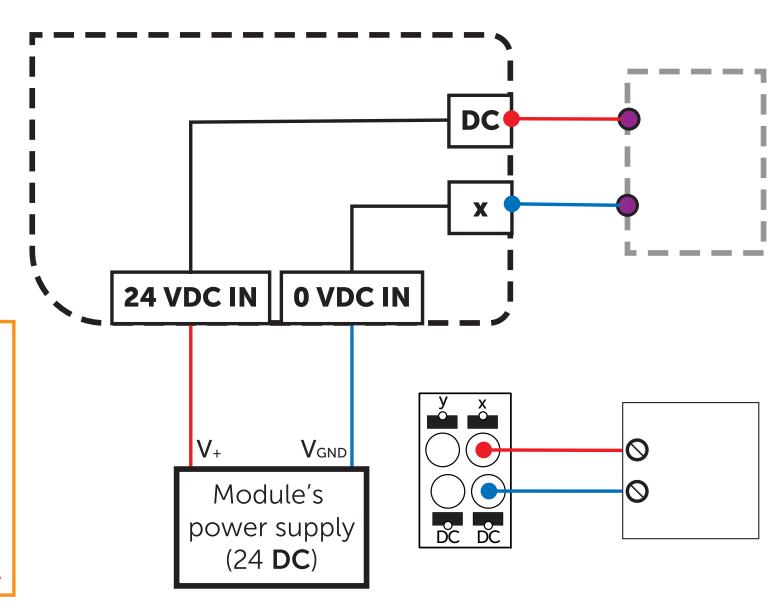


This way of getting the operating voltage for the connected loads is possible, but NOT recommended!

If you do draw the loads through the module's power supply, make sure to not draw more than 2A.

# DOOC-16-C Load connection (This is the recommended way!)


Operating voltage to the operated device directly from the power supply

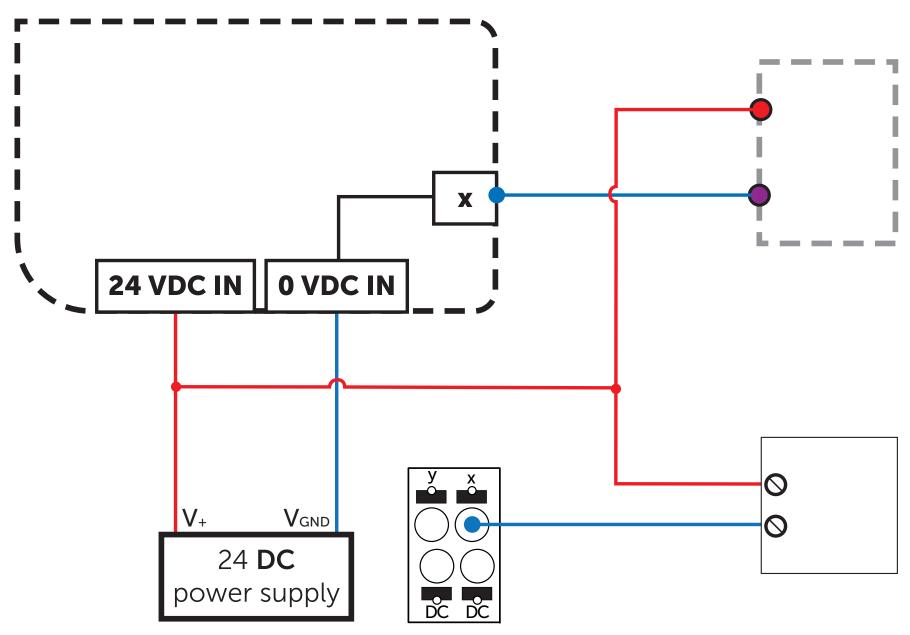

### **DOOC-16-C**


# Internal connections of the open collector outputs



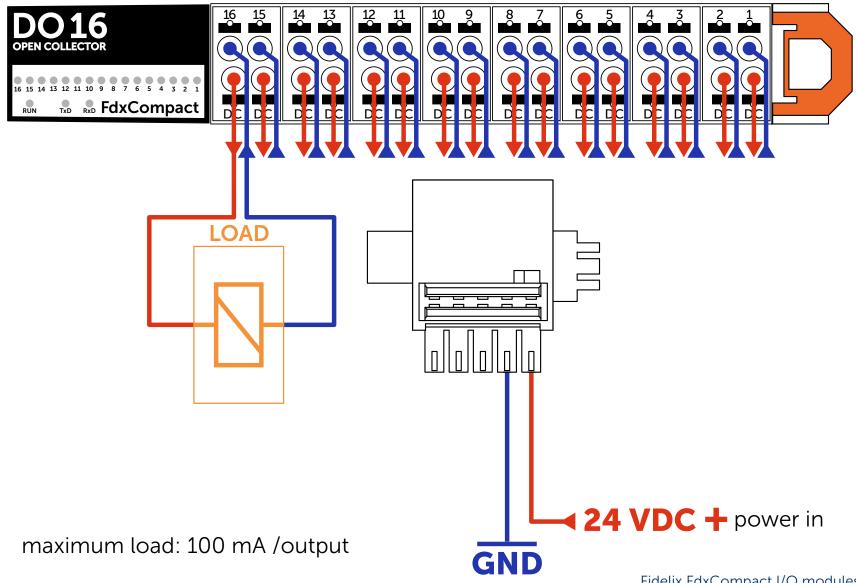


#### **DOOC-16-C**



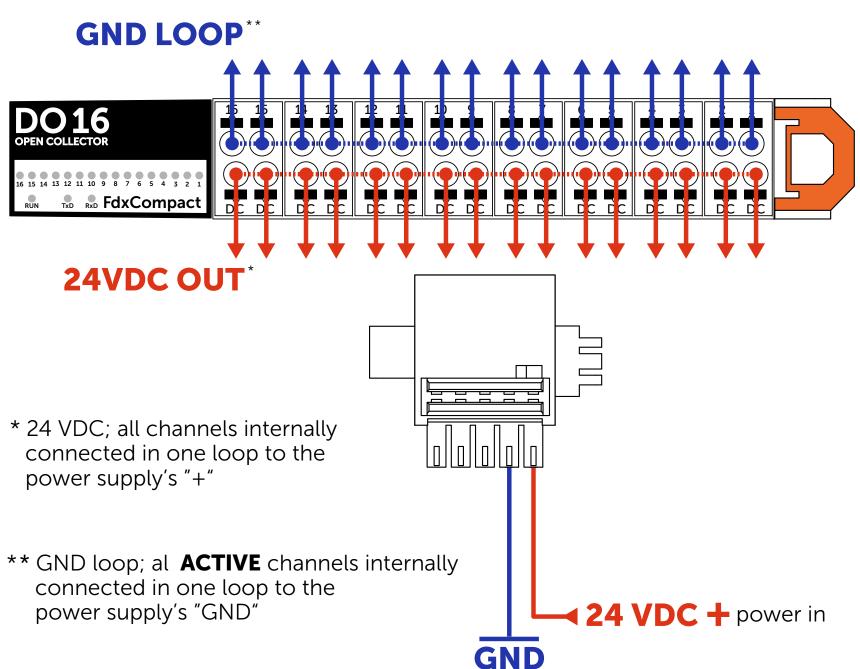

# TRIAC-8-C




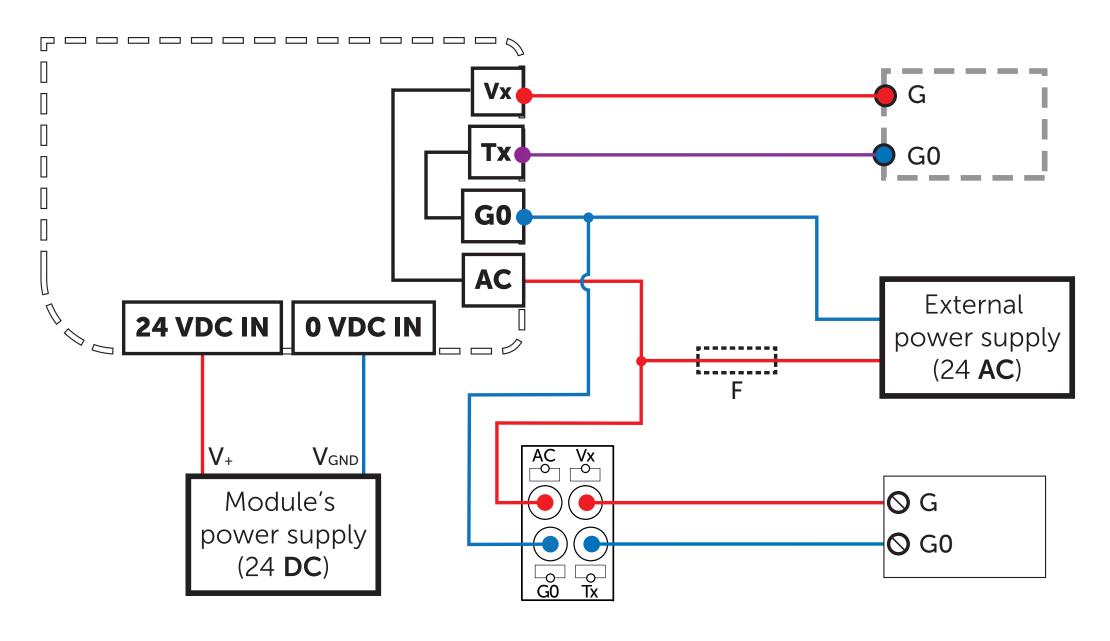



#### **TRIAC output connections**




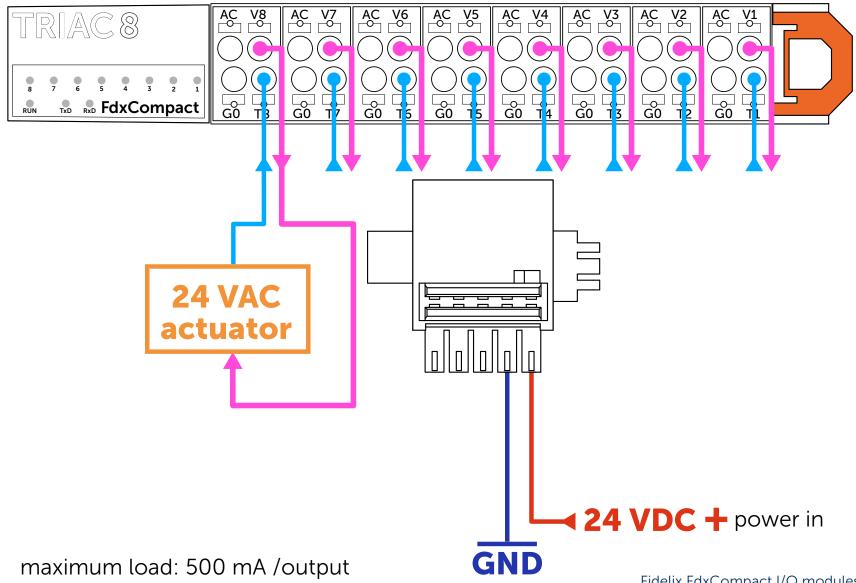





#### Active outputs' connection to the external 24 VAC G0

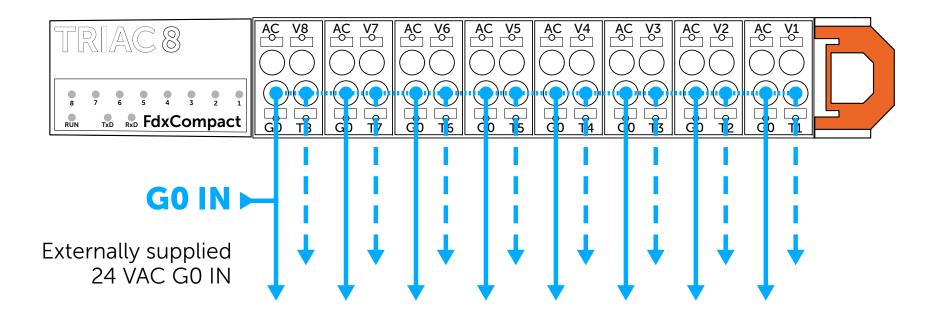

**G0** connectors: all internally connected in one loop (externally provided 24 VAC).

**Tx** connectors: each output, **while ACTIVE**, is internally connected to the same, externally provided 24 VAC G0.